


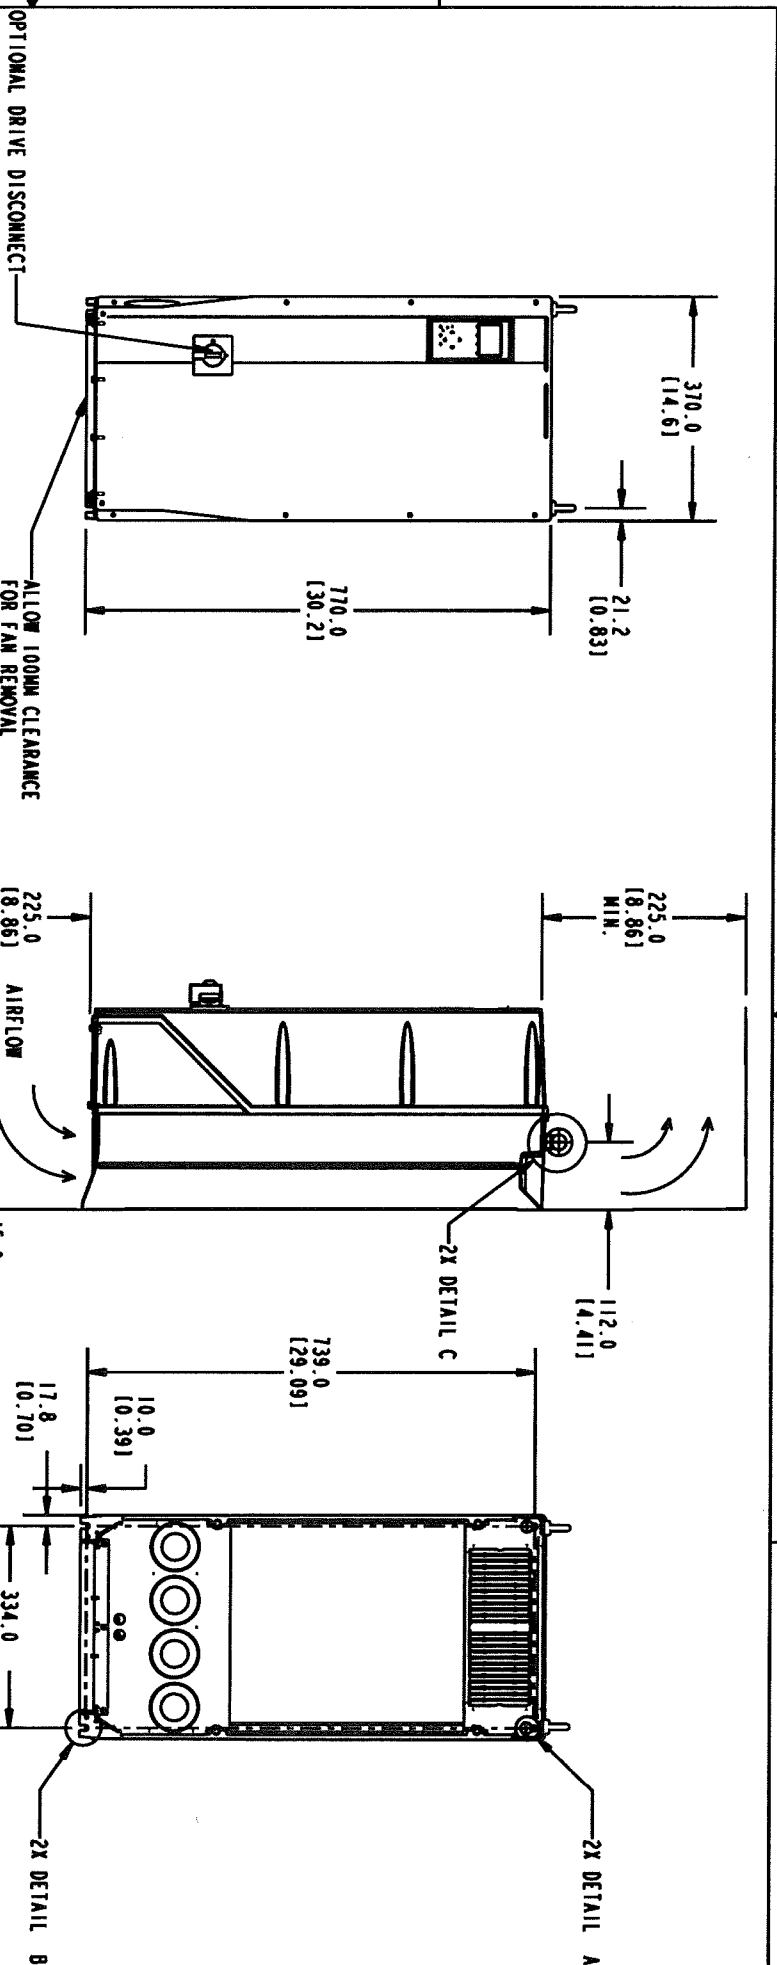

C

FRAME SIZE C2			
VOLTAGE	HP	KW	
208/230	50-60	37-45	
460/600	100-125	75-90	

UNIT COOLING:

THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM FREE SPACE. ALL IP21/UL NEMA TYPE 1 AND IP54/NEMA TYPE 12 UNITS MAY BE MOUNTED SIDE BY SIDE WITH NO MINIMUM CLEARANCE.

NOTICE:

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF DANFOSS DRIVES AND THE INFORMATION CONTAINED HEREIN SHALL BE USED ONLY FOR RECORD AND REFERENCE PURPOSES. SHALL NOT BE USED OR CAUSED TO BE USED IN ANY WAY PREJUDICIAL TO THE INTERESTS OF DANFOSS DRIVES. SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART OR DISCLOSED TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF DANFOSS DRIVES. AND SHALL BE RETURNED UPON REQUEST.

DETAIL A
SCALE 0.250DETAIL B
SCALE 0.250DETAIL C
SCALE 0.250

LATEST E.C.N. NO.: SP08035		E.C.N. PRO-E ENTRY BY/DATE: DK 5/7/08		PLOT SCALE: NONE		PRO-E FILE: P404.C2.650		SHEET: 1 OF 1		DRAWING NO.: 176U8480		REV.: C	
PRO-E ENTRY BY/DATE: JM 08/01/06				DESIGNED BY/DATE: JM 08/01/06				APPROVAL: NONE				TITLE: DWG. REF. SUBMITTAL, C2-TIER 1	
PRO-E ENTRY BY/DATE: JM 08/01/06				DESIGNED BY/DATE: JM 08/01/06				APPROVAL: NONE				TITLE: DWG. REF. SUBMITTAL, C2-TIER 1	
PRO-E ENTRY BY/DATE: JM 08/01/06				DESIGNED BY/DATE: JM 08/01/06				APPROVAL: NONE				TITLE: DWG. REF. SUBMITTAL, C2-TIER 1	

DANFOSS DRIVES
4601 E. 11TH AVE. SUITE 100
DENVER, CO 80231-1100