

NX-series Temperature Control Unit

NX-TC

NX-TC

NX-HTC

Optimize Control by Detecting Status Changes Easily Satisfy Both Productivity and Quality

- Provide optimal control for wide range of temperature control. Furthermore, automatically adapts to changes in the operating environment and measurement object conditions to realize optimum control. (Adaptive control)
- Functions specialized for packaging machines (Temperature Sensors for Packaging Machines and Automatic Filter Adjustment)
- Function specialized for water-cooled extruders (Watercooling Output Adjustment)
- Function for suppressing temperature variations that can be predicted (Disturbance Suppression)



NX-TC2405



NX-TC3405

Features

- Build-in 2-or 4-loop (Ch) PID control or ON/OFF control functions not required temperature control programming
- With heater burnout alarm is available
- Multiple inputs for thermocouple and platinum resistance thermometer input models are available
- Detachable front connector with screwless Push-In Plus terminals for easy installation and maintenance
- Monitoring for ambient temperature is available
- Function added to Unit Versions 1.1 and later
 - A Temperature alarm is possible. (Includes an LBA: Loop Burnout Alarm)
 - Parameters are added to I/O data for adjustment of PID constants, etc.
 - Manipulated variable branching enables a manipulated variable with a calculated slope value or offset to be output to another channel.
- Function added to Unit Versions 1.2 and later
 - Disturbance Suppression (Pre-boost)
 - D-AT (Disturbance Autotuning)
 - Resistance thermometer Pt1000 can be input
- Function added to Unit Versions 1.3 and later
 - The first decimal place in input types "5: K -200 to 1300°C" and "0: Pt100 -200 to 850°C" can be counted as a significant figure.


Sysmac is a trademark or registered trademark of OMRON Corporation in Japan and other countries for OMRON factory automation products. EtherCAT® is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany. EtherNet/IP™ is a trademark of ODVA.

Other company names and product names in this document are the trademarks or registered trademarks of their respective companies.

System Configurations


Connected to a CPU Unit

The following figure shows a system configuration when NX Units are connected to an NX-series CPU Unit.

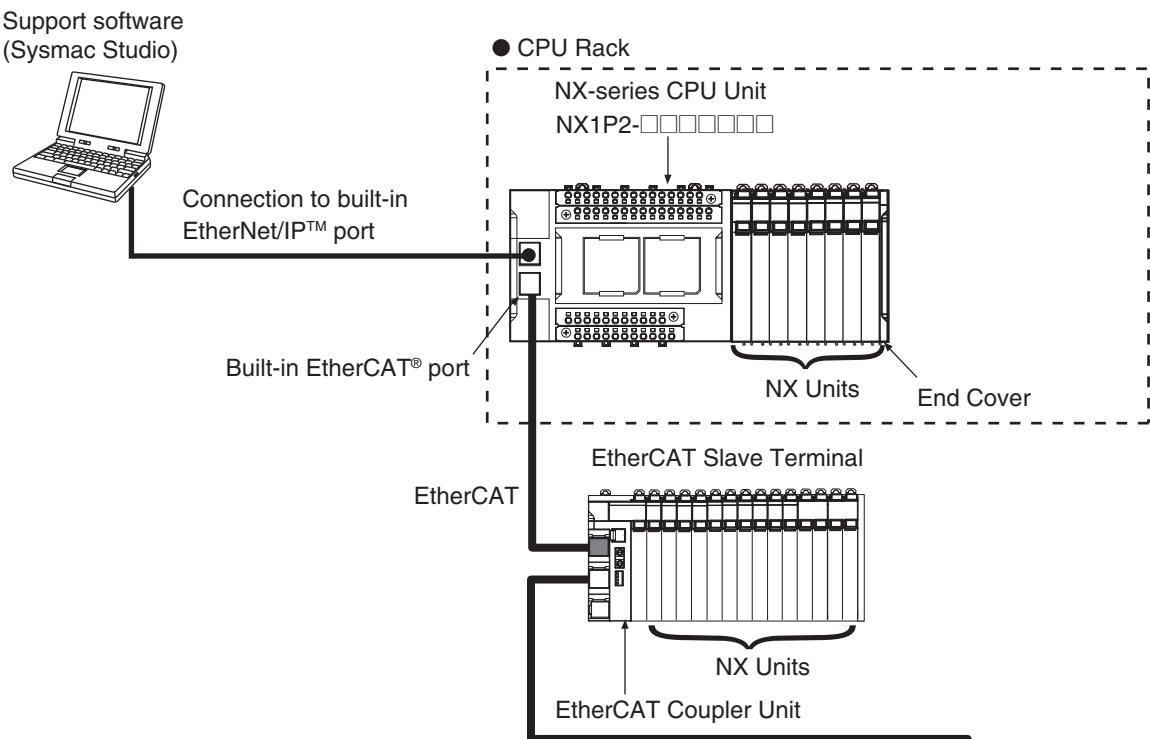

Connected to an EtherCAT Coupler Unit


The following figure shows an example of the system configuration when an EtherCAT Coupler Unit is used as a Communications Coupler Unit.

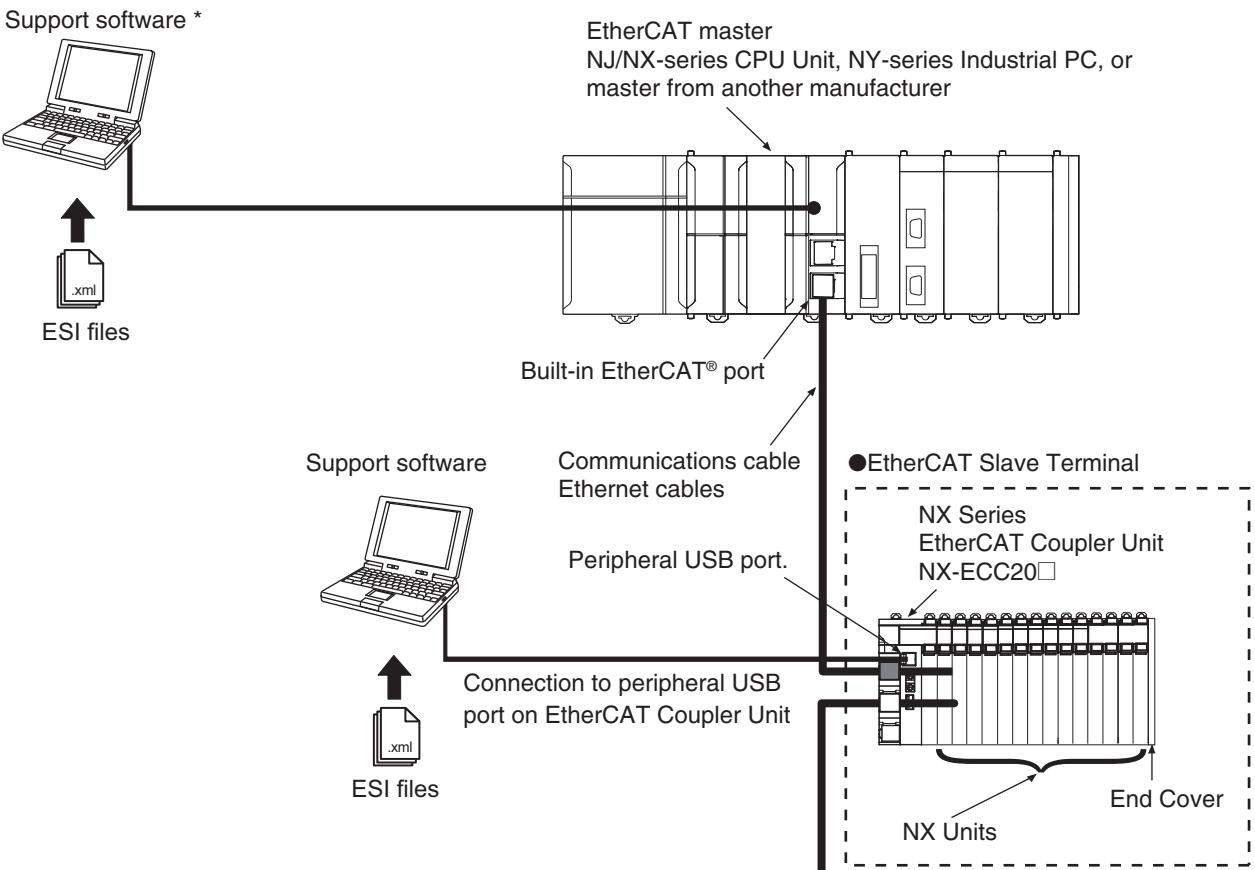

* The connection method for the Sysmac Studio depends on the model of the CPU Unit or Industrial PC.

Note: To check whether NX Units can be connected to your CPU Unit or Communications Coupler Unit, refer to the user's manual for the CPU Unit or Communications Coupler Unit.

Model Number Structure

NX-TC 

(1) (2) (3)

(1) Number of points

No.	Specification
2	2 points
3	4 points

(2) I/O type

No.	Sensor type
4	Multi-input (Thermocouple and Resistance thermometer)

(3) I/O type

No.	Control	Output		Number of CT input points per channel	I/O Refreshing Methods
		Output	Number of output points per channel		
05	Standard control	Voltage output (for driving SSR)	1 point per channel	1 point per channel	Free-Run refreshing
06			1 point per channel	None.	
07	Heating/cooling control		2 points per channel	None.	
08	Standard control	Linear current output	1 point per channel	None.	

N
X
·
T
C

N
X
·
H
T
C

Ordering Information

Applicable standards

Refer to the OMRON website (www.ia.omron.com) or ask your OMRON representative for the most recent applicable standards for each model.

Temperature Control Units

Unit type	Product name	Specification							Model		
		Number of channels	Input type	Output	Output capacity	CT Input capacity	Control type	Conversion time			
NX Series Temperature Control Unit	Temperature Control Unit 2Ch type	2 Ch	Multi-input (Thermocouple and Resistance thermometer)	Voltage output (for driving SSR)	2 points	2 points	Standard Control	50 m sec	Free-Run refreshing	NX-TC2405	
				Voltage output (for driving SSR)		None	Standard Control			NX-TC2406	
	Temperature Control Unit 4Ch type	4 Ch		Linear current output	2 points	None	Standard Control			NX-TC2407	
				Voltage output (for driving SSR)	4 points	4 points	Standard Control			NX-TC2408	
				Voltage output (for driving SSR)		None	Standard Control			NX-TC3405	
				Voltage output (for driving SSR)	8 points	None	Heating and Cooling Control			NX-TC3406	
				Linear current output	4 points	None	Standard Control			NX-TC3407	
										NX-TC3408	

Optional Products

Product name	Specification	Model
Unit/Terminal Block Coding Pins	Pins for 10 Units (30 terminal block pins and 30 Unit pins)	NX-AUX02

Product name	Specification	Model
Current Transformer (CT)	Hole diameter: 5.8 mm	E54-CT1
	Hole diameter: 5.8 mm	E54-CT1L *
	Hole diameter: 12.0 mm	E54-CT3
	Hole diameter: 12.0 mm	E54-CT3L *

* Lead wires are included with these CTs. If UL certification is required, use these CTs.

Accessories

Not included.

General Specifications

Item	Specification
Enclosure	Mounted in a panel
Grounding method	Ground to 100 Ω or less
Operating environment	Ambient operating temperature 0 to 55°C
	Ambient operating humidity 10 to 95% (with no condensation or icing)
	Atmosphere Must be free from corrosive gases.
	Ambient storage temperature -25 to 70°C (with no condensation or icing)
	Altitude 2,000 m max.
	Pollution degree Pollution degree 2 or less: Conforms to JIS B 3502 and IEC 61131-2.
	Noise immunity Conforms to IEC 61000-4-4, 2 kV (power supply line)
	Overvoltage category Category II: Conforms to JIS B 3502 and IEC 61131-2.
	EMC immunity level Zone B
	Vibration resistance Conforms to IEC 60068-2-6. 5 to 8.4 Hz with amplitude of 3.5 mm, 8.4 to 150 Hz, acceleration of 9.8 m/s ² 100 min each in X, Y, and Z directions (10 sweeps of 10 min each = 100 min total)
	Shock resistance Conforms to IEC 60068-2-27. 147 m/s ² , 3 times each in X, Y, and Z directions
	Insulation resistance 20 MΩ min. between isolated circuits (at 100 VDC)
	Dielectric strength 510 VAC between isolated circuits for 1 minute at a leakage current of 5 mA max.
Applicable standards *	cULus: Listed (UL 61010-2-201), ANSI/ISA 12.12.01, EU: EN 61131-2, RCM, KC: KC Registration, NK, LR, BV, UKCA

* Refer to the OMRON website (www.ia.omron.com) or ask your OMRON representative for the most recent applicable standards for each model.

NX-TC

NX-HTC

List of Functions

Function name	Description	Applicable Units
Free-Run Refreshing	With this I/O refreshing method, the refresh cycle of the NX bus and the I/O refresh cycles of the NX Units are asynchronous.	All models
Selecting Channel To Use	This function disables control processing, error detection, and output for unused channels. The conversion time for its own Unit will not be shortened even if errors are disabled.	All models
Input Functions	Input Type Setting	This function sets the input type of the sensor connected to the temperature input.
	Temperature Unit Setting (°C/°F)	This function sets the temperature units for measured values to °C (Celsius) or °F (Fahrenheit).
	Decimal Point Position Setting	This function sets the number of digits to be displayed after the decimal point for INT type measured values and set point parameters.
	Cold Junction Compensation Enable/Disable Setting	This function enables or disables cold junction compensation using the cold junction sensor that is mounted on the terminal block when a thermocouple input is used.
	Temperature Input Correction	This function corrects measured values. When there are variations in the sensor or when there is a difference in measured value from other measuring instruments. One-point correction and two-point correction methods are provided.
	Input Digital Filter	This function sets the time constant applied to the first-order lag operation filter so that the noise components mixed with the measured value are eliminated.
	Measuring the Ambient Temperature Around Terminals	This function measures the temperature around the terminals of the Temperature Control Unit.
Control Processing	ON/OFF Control	This control function uses a preset set point to turn off the control output when the temperature reaches the set point during control.
	PID Control	PID control is a combination of proportional (P) control, integral (I) control, and differential (D) control. It is a control function that feeds back the detected value to the set point so that they conform to each other.
	Heating/Cooling Control	This function controls both heating and cooling.
	Run or Stop Controls	This function starts and stops temperature control.
	Direct/Reverse Operation	This function specifies direct or reverse operation.
	Manual MV (Manual Manipulated Variable)	This function outputs the specified manipulated variable during PID control.
	MV at Error	This function outputs a fixed manipulated variable when a Sensor Disconnected Error occurs.
	MV Limit	This function adds a limit to the manipulated variable calculated by PID control and outputs it.
	Load Rejection MV	This function performs a preset output operation if the Temperature Control Unit connected to the CPU Unit cannot receive the output setting values from the CPU Unit due to an NX bus error or CPU watchdog timer error. This function performs a preset output operation if the Slave Terminal cannot receive the output setting values due to a communications error between the Temperature Control Unit and the Communications Coupler Unit host or due to an error on the NX bus.
	MV Branch *1	The manipulated variables calculated by the slope or offset are output to the branch-destination channel based on the manipulated variables of the branch-source channel.
	Load Short-circuit Protection	This function protects output circuits of the Temperature Control Unit when an external device connected to the control output is short-circuited.
	Disturbance Suppression (Pre-boost) *2	This function suppresses temperature variations by adding a preset manipulated variable before temperature variations occur due to a disturbance.

Function name		Description	Applicable Units
Tuning	AT (Autotuning)	This is a tuning method that derives the PID constant. This function automatically calculates the PID constant by the limit cycle method according to the characteristics of the control target.	All models
	Automatic Filter Adjustment	This is a tuning method that automatically adjusts the input digital filter. This function is primarily for packing machines. It suppresses periodic temperature variations.	Standard control type models
	Water-cooling Output Adjustment	This is a tuning method that automatically adjusts hunting. This function is primarily for water-cooled extruders. It suppresses temperature variations caused by the cooling water output.	Heating/cooling control type models
	Adaptive Control	This is a tuning method that can maintain high control performance by following system changes. This function maintains control performance even if temperature variation factors such as environmental change and equipment deterioration occur during a long-term equipment operation.	Standard control type models
	Notifying the Update of Tuning Parameters	This function notifies that the Temperature Control Unit has automatically updated the parameters by tuning.	All models
Control Output	D-AT (Disturbance Autotuning) *2	This function automatically calculates disturbance suppression (Pre-boost) function parameters such as FF waiting time, FF operation time, and FF segments 1 to 4 manipulated variables.	Standard control type models
	Control Period	This function sets the period when the ON/OFF time ratio is changed for voltage output (for driving SSR) in time-proportional operation.	Models with voltage output (for driving SSR)
	Minimum Output ON/OFF Band	This function specifies the minimum ON/OFF bands for the heating side control output or the cooling side control output. This function can be used to prevent deterioration of mechanical relays when mechanical relays are used in the actuators connected to the output terminals.	Models with voltage output (for driving SSR)
	Output Signal Range Setting	This function sets the output signal range of the linear current output. You can specify 4 to 20 mA or 0 to 20 mA.	Models with linear current output
Error Detection	Limiting Simultaneous Outputs	This function limits the number of outputs that turn ON simultaneously by shifting the control period of each output and restricting the upper limit of the manipulated variable. You can set a delay between outputs, which allows delays in output device operation that can occur when outputs are switched.	Standard control type models with voltage output (for driving SSR)
	Sensor Disconnection Detection	This function detects disconnections in temperature sensors. It also detects that the measured value of the temperature sensor is outside the input indication range.	All models
	Heater Burnout Detection	This function detects heater burnouts. A heater burnout is detected if the control output is ON and the heater current is equal to or less than the heater burnout detection current.	Models with CT input
	SSR Failure Detection	This function detects SSR failures. An SSR failure is detected if the control output is OFF and the leakage current is equal to or greater than the SSR failure detection current. An SSR failure is a failure that is caused by an SSR short-circuit.	Models with CT input
	Temperature Alarms *1	Function for detecting a deviation or an error in the measured value as an alarm. Alarm operation corresponding to the use can be performed by selecting "Alarm type".	All models
	LBA (Loop Burnout Alarm) *1	Function for detecting, as an alarm, the error location in the control loop when there is no change in the measured value while a control deviation equal to or more than the threshold value exists between the set point and the measured value.	All models

*1. Can be used with Unit version Ver.1.1 or later.

*2. Can be used with Unit version Ver.1.2 or later.

Individual Specifications

Temperature Control Unit (2-Channel Type) NX-TC2405

Unit name	Temperature Control Unit (2-Channel Type)	Model	NX-TC2405
Number of Channels	2 channels	Control type	Standard control
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (2 points per Unit) CT Input: 1 point per channel (2 points per Unit) Control Output: 1 point per channel (2 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals)
I/O refreshing method	Free-Run Refreshing		
Indicators	TS indicator and output indicators 	CT Input section	<p>CT current input range 0 to 0.125 A</p> <p>Input resistance Approx. 2.7 Ω</p> <p>Connectable CTs E54-CT1, E54-CT3, E54-CT1L, and E54-CT3L</p> <p>Maximum heater current 50 A AC</p> <p>Resolution 0.1 A</p> <p>Overall accuracy (25°C) $\pm 5\%$ (full scale) ± 1 digit</p> <p>Influence of temperature (0 to 55°C) $\pm 2\%$ (full scale) ± 1 digit</p> <p>Conversion time 50 ms per Unit</p>
Sensor Input section	<p>Temperature sensor #1</p> <ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) <p>Input conversion range $\pm 20^\circ\text{C}$ of the input range</p> <p>Absolute maximum rating ± 130 mV</p> <p>Input impedance 20 kΩ min.</p> <p>Resolution 0.1°C max.</p> <p>Reference accuracy *2</p> <p>Temperature coefficient *2</p> <p>Cold junction compensation error $\pm 1.2^\circ\text{C}$ *2 *3</p> <p>Input disconnection detection current Approx. 0.1 μA</p> <p>Input detection current 0.25 mA</p> <p>Effect of conductor resistance</p> <ul style="list-style-type: none"> Thermocouple input: $0.1^\circ\text{C}/\Omega$ (100 Ω or less per conductor) Platinum resistance thermometer input: $0.06^\circ\text{C}/\Omega$ (20 Ω or less per conductor) <p>Warm-up period 30 minutes</p> <p>Conversion time 50 ms per Unit</p>	Control Output section	<p>Control output type and number of control outputs per channel Voltage output for driving SSR, 1 point per channel</p> <p>Internal I/O common PNP</p> <p>Control Period 0.1, 0.2, 0.5, 1 to 99s</p> <p>Manipulated variable -5 to +105%</p> <p>Resolution ---</p> <p>Rated Voltage 24 VDC</p> <p>Operating Load Voltage Range 15 to 28.8 VDC</p> <p>Maximum load current 21 mA per point, 42 mA per Unit</p> <p>Maximum Inrush Current 0.3 A max. per point, 10 ms max.</p> <p>Allowable load resistance ---</p> <p>Leakage current 0.1 mA max.</p> <p>Residual voltage 1.5 V max.</p> <p>Load Short-circuit Protection Provided</p> <p>Output range ---</p> <p>Overall accuracy (25°C) ---</p> <p>Influence of temperature (0 to 55°C) ---</p>
Dimensions	12 mm (W) \times 100 mm (H) \times 71 mm (D)	Isolation method	<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator No isolation between internal circuits and CT inputs Between control output and internal circuit: Photocoupler No isolation between control outputs
Insulation resistance	20 M Ω min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.45 W max. Connected to Communications Coupler Unit 1.10 W max. 	Current consumption from I/O power supply	20 mA max.	
Weight	75 g max.			
Circuit configuration				
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>			
Terminal connection diagram				

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.

A calibration control number is displayed both on the terminal block and the Unit.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (2-Channel Type) NX-TC2406

Unit name	Temperature Control Unit (2-Channel Type)	Model	NX-TC2406	
Number of Channels	2 channels	Control type	Standard control	
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (2 points per Unit) CT input: None Control Output: 1 point per channel (2 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals)	
I/O refreshing method	Free-Run Refreshing			
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range</p> <p>Input resistance</p> <p>Connectable CTs</p> <p>Maximum heater current</p> <p>Resolution</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p> <p>Conversion time</p>	
Sensor Input section	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 		<p>Control output type and number of control outputs per channel</p> <p>Internal I/O common</p> <p>Control Period</p> <p>Manipulated variable</p>	
			<p>Resolution</p>	
			<p>Rated Voltage</p>	
			<p>Operating Load Voltage Range</p>	
			<p>Maximum load current</p>	
			<p>Maximum Inrush Current</p>	
			<p>Allowable load resistance</p>	
			<p>Leakage current</p>	
	<ul style="list-style-type: none"> Input conversion range Absolute maximum rating Input impedance Resolution Reference accuracy Temperature coefficient Cold junction compensation error Input disconnection detection current Input detection current Effect of conductor resistance Warm-up period Conversion time 	Control Output section	<p>Residual voltage</p>	
			<p>Load Short-circuit Protection</p>	
			<p>Output range</p>	
			<p>Overall accuracy (25°C)</p>	
			<p>Influence of temperature (0 to 55°C)</p>	
			<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs 	
			<p>Dimensions</p>	
Dimensions	12 mm (W) x 100 mm (H) x 71 mm (D)	Isolation method	<p>12 mm (W) x 100 mm (H) x 71 mm (D)</p>	
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.	
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal	

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.25 W max. Connected to Communications Coupler Unit 0.95 W max. 	Current consumption from I/O power supply	20 mA max.
Weight	75 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>		
Terminal connection diagram			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.

A calibration control number is displayed both on the terminal block and the Unit.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (2-Channel Type) NX-TC2407

Unit name	Temperature Control Unit (2-Channel Type)	Model	NX-TC2407	
Number of Channels	2 channels	Control type	Heating and cooling control	
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (2 points per Unit) CT input: None Control Output: 2 point per channel (4 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals)	
I/O refreshing method	Free-Run Refreshing			
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range</p> <p>Input resistance</p> <p>Connectable CTs</p> <p>Maximum heater current</p> <p>Resolution</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p> <p>Conversion time</p>	
Sensor Input section	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 		<p>Control output type and number of control outputs per channel</p> <p>Internal I/O common</p> <p>Control Period</p> <p>Manipulated variable</p>	
			<p>Resolution</p>	
			<p>Rated Voltage</p>	
			<p>Operating Load Voltage Range</p>	
			<p>Maximum load current</p>	
			<p>Maximum Inrush Current</p>	
			<p>Allowable load resistance</p>	
			<p>Leakage current</p>	
	<ul style="list-style-type: none"> Input conversion range Absolute maximum rating Input impedance Resolution Reference accuracy Temperature coefficient Cold junction compensation error Input disconnection detection current Input detection current Effect of conductor resistance Warm-up period Conversion time 	Control Output section	<p>Residual voltage</p>	
			<p>Load Short-circuit Protection</p>	
			<p>Output range</p>	
			<p>Overall accuracy (25°C)</p>	
			<p>Influence of temperature (0 to 55°C)</p>	
			<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs 	
			<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs 	
Dimensions	12 mm (W) x 100 mm (H) x 71 mm (D)	Isolation method	<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs 	
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.	
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal	

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.30 W max. Connected to Communications Coupler Unit 1.00 W max. 	Current consumption from I/O power supply	20 mA max.
Weight	75 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>		
Terminal connection diagram			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.

A calibration control number is displayed both on the terminal block and the Unit.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (2-Channel Type) NX-TC2408

Unit name	Temperature Control Unit (2-Channel Type)	Model	NX-TC2408
Number of Channels	2 channels	Control type	Standard control
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (2 points per Unit) CT input: None Control Output: 1 point per channel (2 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals)
I/O refreshing method	Free-Run Refreshing		
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range</p> <p>Input resistance</p> <p>Connectable CTs</p> <p>Maximum heater current</p> <p>Resolution</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p> <p>Conversion time</p>
Sensor Input section	Temperature sensor *1		<p>Control output type and number of control outputs per channel</p> <p>Internal I/O common</p> <p>Control Period</p> <p>Manipulated variable</p>
	Input conversion range		Linear current output, one output per channel
	Absolute maximum rating		---
	Input impedance		---
	Resolution		---
	Reference accuracy		1/10,000
	Temperature coefficient		24 VDC
	Cold junction compensation error		15 to 28.8 VDC
	Input disconnection detection current		Maximum load current
	Input detection current		---
	Effect of conductor resistance		Maximum Inrush Current
	Warm-up period		Allowable load resistance
	Conversion time		350 Ω or less, or greater than 350 Ω but no more than 600 Ω *3
			Leakage current
Dimensions	12 mm (W) × 100 mm (H) × 71 mm (D)	Isolation method	<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.25 W max. Connected to Communications Coupler Unit 0.95 W max. 	Current consumption from I/O power supply	20 mA max.
Weight	75 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation: The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>		
Terminal connection diagram			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.


A calibration control number is displayed both on the terminal block and the Unit.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. To use an allowable load resistance greater than 350 Ω but not exceeding 600 Ω, SHT1 and SHT2 must be shorted with a shorting cable. For details, refer to the NX-series Temperature Control Units User's Manual (Cat. No. W523).

*4. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (4-Channel Type) NX-TC3405

Unit name	Temperature Control Unit (4-Channel Type)	Model	NX-TC3405
Number of Channels	4 channels	Control type	Standard control
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (4 points per Unit) CT Input: 1 point per channel (4 points per Unit) Control Output: 1 point per channel (4 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals x 2)
I/O refreshing method	Free-Run Refreshing		
Indicators	TS indicator and output indicators 	CT Input section	CT current input range 0 to 0.125 A Input resistance Approx. 2.7 Ω Connectable CTs E54-CT1, E54-CT3, E54-CT1L, and E54-CT3L Maximum heater current 50 A AC Resolution 0.1 A Overall accuracy (25°C) ±5% (full scale) ±1 digit Influence of temperature (0 to 55°C) ±2% (full scale) ±1 digit Conversion time 50 ms per Unit
Sensor Input section	Temperature sensor *1 <ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 		Control output type and number of control outputs per channel Voltage output for driving SSR, 1 point per channel Internal I/O common PNP Control Period 0.1, 0.2, 0.5, 1 to 99s Manipulated variable -5 to +105%
	Input conversion range ±20°C of the input range *2		Resolution ---
	Absolute maximum rating ±130 mV		Rated Voltage 24 VDC
	Input impedance 20 kΩ min.		Operating Load Voltage Range 15 to 28.8 VDC
	Resolution 0.1°C max.		Maximum load current 21 mA per point, 84 mA per Unit
	Reference accuracy *2		Maximum Inrush Current 0.3 A max. per point, 10 ms max.
	Temperature coefficient *2		Allowable load resistance ---
	Cold junction compensation error ±1.2°C *2 *3		Leakage current 0.1 mA max.
	Input disconnection detection current Approx. 0.1 uA		Residual voltage 1.5 V max.
Dimensions	Input detection current 0.25 mA	Control Output section	Load Short-circuit Protection Provided
	Effect of conductor resistance <ul style="list-style-type: none"> Thermocouple input: 0.1°C/Ω (100 Ω or less per conductor) Platinum resistance thermometer input: 0.06°C/Ω (20 Ω or less per conductor) 		Output range ---
	Warm-up period 30 minutes		Overall accuracy (25°C) ---
	Conversion time 50 ms per Unit		Influence of temperature (0 to 55°C) ---
	24 mm (W) ×100 mm (H) ×71 mm (D)		<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator No isolation between internal circuits and CT inputs Between control output and internal circuit: Photocoupler No isolation between control outputs
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.80 W max. Connected to Communications Coupler Unit 1.35 W max. 	Current consumption from I/O power supply	20 mA max.	
Weight	140 g max.			
Circuit configuration				
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>			
Terminal connection diagram				

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.


A calibration control number is displayed both on the terminal block and the Unit.

In order to distinguish left and right terminal blocks, each terminal block has either a letter "L" (left side) or "R" (right side) appended at the end of a calibration control number.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (4-Channel Type) NX-TC3406

Unit name	Temperature Control Unit (4-Channel Type)	Model	NX-TC3406
Number of Channels	4 channels	Control type	Standard control
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (4 points per Unit) CT input: None Control Output: 1 point per channel (4 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals x 2)
I/O refreshing method	Free-Run Refreshing		
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range ---</p> <p>Input resistance ---</p> <p>Connectable CTs ---</p> <p>Maximum heater current ---</p> <p>Resolution ---</p> <p>Overall accuracy (25°C) ---</p> <p>Influence of temperature (0 to 55°C) ---</p> <p>Conversion time ---</p>
Sensor Input section	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 	Control Output section	<p>Control output type and number of control outputs per channel Voltage output for driving SSR, 1 point per channel</p> <p>Internal I/O common PNP</p> <p>Control Period 0.1, 0.2, 0.5, 1 to 99s</p> <p>Manipulated variable -5 to +105%</p>
			<p>Resolution ---</p>
			<p>Rated Voltage 24 VDC</p>
			<p>Operating Load Voltage Range 15 to 28.8 VDC</p>
			<p>Maximum load current 21 mA per point, 84 mA per Unit</p>
			<p>Maximum Inrush Current 0.3 A max. per point, 10 ms max.</p>
			<p>Allowable load resistance ---</p>
			<p>Leakage current 0.1 mA max.</p>
	<ul style="list-style-type: none"> ±20°C of the input range *2 ±130 mV 20 kΩ min. 0.1°C max. *2 *2 ±1.2°C *2 *3 Approx. 0.1 uA 0.25 mA 0.1°C/Ω (100 Ω or less per conductor) 0.06°C/Ω (20 Ω or less per conductor) 30 minutes 50 ms per Unit 	Isolation method	<p>Residual voltage 1.5 V max.</p> <p>Load Short-circuit Protection Provided</p> <p>Output range ---</p> <p>Overall accuracy (25°C) ---</p> <p>Influence of temperature (0 to 55°C) ---</p>
			<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs
Dimensions	24 mm (W) × 100 mm (H) × 71 mm (D)		
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.70 W max. Connected to Communications Coupler Unit 1.25 W max. 	Current consumption from I/O power supply	20 mA max.
Weight	140 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>		
Terminal connection diagram			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.

A calibration control number is displayed both on the terminal block and the Unit.

In order to distinguish left and right terminal blocks, each terminal block has either a letter "L" (left side) or "R" (right side) appended at the end of a calibration control number.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (4-Channel Type) NX-TC3407

Unit name	Temperature Control Unit (4-Channel Type)	Model	NX-TC3407	
Number of Channels	4 channels	control type	heating and cooling control	
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (4 points per Unit) CT input: None Control Output: 2 point per channel (8 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals x 2)	
I/O refreshing method	Free-Run Refreshing			
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range</p> <p>Input resistance</p> <p>Connectable CTs</p> <p>Maximum heater current</p> <p>Resolution</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p> <p>Conversion time</p>	
Sensor Input section	<p>Temperature sensor *1</p> <ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 		<p>Control output type and number of control outputs per channel</p> <p>Internal I/O common</p> <p>Control Period</p> <p>Manipulated variable</p>	
			<p>Voltage output for driving SSR, 2 point per channel</p> <p>PNP</p> <p>0.1, 0.2, 0.5, 1 to 99s</p> <p>• Heating: 0 to +105%</p> <p>• Cooling: 0 to +105%</p>	
	<p>Input conversion range</p> <p>Absolute maximum rating</p>	Control Output section	<p>Resolution</p>	
			<p>24 VDC</p>	
	<p>Input impedance</p> <p>Resolution</p>		<p>Operating Load Voltage Range</p>	
			<p>15 to 28.8 VDC</p>	
	<p>Reference accuracy</p> <p>Temperature coefficient</p>		<p>Maximum load current</p>	
			<p>21 mA per point, 168 mA per Unit</p>	
	<p>Cold junction compensation error</p> <p>Input disconnection detection current</p>		<p>Maximum Inrush Current</p>	
			<p>0.3 A max. per point, 10 ms max.</p>	
	<p>Input detection current</p> <p>Effect of conductor resistance</p>		<p>Allowable load resistance</p>	
			<p>---</p>	
	<p>Warm-up period</p> <p>Conversion time</p>		<p>Leakage current</p>	
			<p>0.1 mA max.</p>	
	<p>Residual voltage</p> <p>Load Short-circuit Protection</p> <p>Output range</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p>		<p>1.5 V max.</p> <p>Provided</p> <p>---</p> <p>---</p> <p>---</p>	
Dimensions	24 mm (W) x 100 mm (H) x 71 mm (D)	Isolation method	<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs 	
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.	
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal	

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.75 W max. Connected to Communications Coupler Unit 1.30 W max. 	Current consumption from I/O power supply	20 mA max.																																																
Weight	140 g max.																																																		
Circuit configuration	<p>The diagram illustrates the internal circuitry for the NX-TC. It shows a control output path from an internal circuit through a short-circuit protection stage to a terminal block. The terminal block connects to an I/O power supply and an NX Bus Connector. The temperature sensor input path shows four channels (A1 to A4) connected through an input circuit, isolator, and internal circuit stages to a terminal block. The terminal block connects to an I/O power supply and an NX Bus Connector.</p>																																																		
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit <p>Six orientations are possible</p> <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>																																																		
Terminal connection diagram	<p>The diagram shows two connection diagrams. On the left, the Additional I/O Power Supply Unit is connected to a 24 VDC power source. It has two columns of terminals: A1 (IOV, IOG) and B1 (IOV, IOG). On the right, the Temperature Control Unit NX-TC3407 is shown with a 4x4 terminal block layout. The connections are as follows:</p> <table border="1"> <thead> <tr> <th colspan="2">A1</th> <th colspan="2">B1</th> <th colspan="2">C1</th> <th colspan="2">D1</th> </tr> <tr> <th>OUT1</th> <th>OUT2</th> <th>OUT3</th> <th>OUT4</th> <th>IOG1</th> <th>IOG2</th> <th>IOG3</th> <th>IOG4</th> </tr> </thead> <tbody> <tr> <th>OUT5</th> <th>OUT6</th> <th>OUT7</th> <th>OUT8</th> <th>IOG5</th> <th>IOG6</th> <th>IOG7</th> <th>IOG8</th> </tr> <tr> <th>CJ1+</th> <th>CJ1-</th> <th>CJ2+</th> <th>CJ2-</th> <th>B1/TC1+</th> <th>B2/TC2+</th> <th>B3/TC3+</th> <th>B4/TC4+</th> </tr> <tr> <th>B1/TC1-</th> <th>B2/TC2-</th> <th>B3/TC3-</th> <th>B4/TC4-</th> <th>A1</th> <th>A2</th> <th>A3</th> <th>A4</th> </tr> <tr> <th colspan="2">A8</th> <th colspan="2">B8</th> <th colspan="2">C8</th> <th colspan="2">D8</th> </tr> </tbody> </table> <p>Annotations include: SSR (Solid State Relay), Cold junction sensor, * Do not touch or remove., Resistance thermometer input, and Thermocouple input.</p>			A1		B1		C1		D1		OUT1	OUT2	OUT3	OUT4	IOG1	IOG2	IOG3	IOG4	OUT5	OUT6	OUT7	OUT8	IOG5	IOG6	IOG7	IOG8	CJ1+	CJ1-	CJ2+	CJ2-	B1/TC1+	B2/TC2+	B3/TC3+	B4/TC4+	B1/TC1-	B2/TC2-	B3/TC3-	B4/TC4-	A1	A2	A3	A4	A8		B8		C8		D8	
A1		B1		C1		D1																																													
OUT1	OUT2	OUT3	OUT4	IOG1	IOG2	IOG3	IOG4																																												
OUT5	OUT6	OUT7	OUT8	IOG5	IOG6	IOG7	IOG8																																												
CJ1+	CJ1-	CJ2+	CJ2-	B1/TC1+	B2/TC2+	B3/TC3+	B4/TC4+																																												
B1/TC1-	B2/TC2-	B3/TC3-	B4/TC4-	A1	A2	A3	A4																																												
A8		B8		C8		D8																																													

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.


A calibration control number is displayed both on the terminal block and the Unit.

In order to distinguish left and right terminal blocks, each terminal block has either a letter "L" (left side) or "R" (right side) appended at the end of a calibration control number.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Temperature Control Unit (4-Channel Type) NX-TC3408

Unit name	Temperature Control Unit (4-Channel Type)	Model	NX-TC3408
Number of Channels	4 channels	Control type	Standard control
Number of points per channel	<ul style="list-style-type: none"> Temperature input: 1 point per channel (4 points per Unit) CT input: None Control Output: 1 point per channel (4 points per Unit) 	External connection terminal	Screwless clamping terminal block (16 terminals x 2)
I/O refreshing method	Free-Run Refreshing		
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	<p>CT current input range</p> <p>Input resistance</p> <p>Connectable CTs</p> <p>Maximum heater current</p> <p>Resolution</p> <p>Overall accuracy (25°C)</p> <p>Influence of temperature (0 to 55°C)</p> <p>Conversion time</p>
Sensor Input section	Temperature sensor *1	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire), Pt1000 (three-wire) 	<p>Control output type and number of control outputs per channel</p> <p>Internal I/O common</p> <p>Control Period</p> <p>Manipulated variable</p>
	Input conversion range		Linear current output, one output per channel
	Absolute maximum rating		---
	Input impedance		---
	Resolution		---
	Reference accuracy		5 to +105%
	Temperature coefficient		1/10,000
	Cold junction compensation error		24 VDC
	Input disconnection detection current		15 to 28.8 VDC
	Input detection current		---
	Effect of conductor resistance		---
	Warm-up period		---
	Conversion time		---
	Dimensions		350 Ω or less, or greater than 350 Ω but no more than 600 Ω *3
	Insulation resistance		30 minutes
	I/O power supply method		0.1 to 20 mA
<p>Dimensions</p> <p>Insulation resistance</p> <p>I/O power supply method</p>		Isolation method	<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator Between control output and internal circuit: Photocoupler No isolation between control outputs
<p>Dimensions</p> <p>Insulation resistance</p> <p>I/O power supply method</p>		Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
<p>Dimensions</p> <p>Insulation resistance</p> <p>I/O power supply method</p>		Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.65 W max. Connected to Communications Coupler Unit 1.25 W max. 	Current consumption from I/O power supply	30 mA max.
Weight	140 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit <p>Six orientations are possible</p> <p>Limitation:</p> <p>The cold junction compensation error is limited by the mounting orientation and the type or power consumption of the adjacent Unit. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 27.</p>		
Terminal connection diagram			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 24.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 25.

For thermocouple inputs, reference accuracy and cold junction compensation error are guaranteed for a set of a Temperature Control Unit and a terminal block on which a cold junction sensor is mounted.

Be sure to use the terminal block and the Temperature Control Unit with the same calibration control number together.

A calibration control number is displayed both on the terminal block and the Unit.

In order to distinguish left and right terminal blocks, each terminal block has either a letter "L" (left side) or "R" (right side) appended at the end of a calibration control number.

Make sure to return the terminal block to which a cold junction sensor is mounted and the Unit together.

*3. To use an allowable load resistance greater than 350 Ω but not exceeding 600 Ω , either SHT1 and SHT2, or SHT3 and SHT4 must be shorted with a shorting cable.

For details, refer to the *NX-series Temperature Control Units User's Manual* (Cat. No. W523).

*4. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 27.

Input types

The settings are shown in the following table.

Setting name*1	Display of support software	Description	Default	Setting range	Unit	Change application timing
Ch□ input type	Ch□ Input Type	Sets the input type of sensors connected to temperature input.	5: K -200 to 1300°C	*2	No	After Unit restart

*1. □ represents the channel number.

*2. The setting ranges are shown below. However, the 21, 22, and 23 input types can be used with Unit versions 1.2 and later.

Set values	Input types		Input indication range	Remarks
	Sensor	Input setting range		
0	Pt100	-200 to 850°C/-300 to 1500°F	-220 to 870°C/-340 to 1540°F	Resistance thermometer
1	Pt100	-199.9 to 500.0°C/-199.9 to 900.0°F	-219.9 to 520.0°C/-239.9 to 940.0°F	
2	Pt100	-0.0 to 100.0°C/0.0 to 210.0°F	-20.0 to 120.0°C/-40.0 to 250.0°F	
3	JPt100	-199.9 to 500.0°C/-199.9 to 900.0°F	-219.9 to 520.0°C/-239.9 to 940.0°F	
4	JPt100	-0.0 to 100.0°C/0.0 to 210.0°F	-20.0 to 120.0°C/-40.0 to 250.0°F	
5	K	-200 to 1300°C/-300 to 2300°F	-220 to 1320°C/-340 to 2340°F	
6	K	-20.0 to 500.0°C/0.0 to 900.0°F	-40.0 to 520.0°C/-40.0 to 940.0°F	
7	J	-100 to 850°C/-100.0 to 1500°F	-120 to 870°C/-140 to 1540°F	
8	J	-20.0 to 400.0°C/0.0 to 750.0°F	-40.0 to 420.0°C/-40.0 to 790.0°F	
9	T	-200 to 400°C/-300 to 700°F	-220 to 420°C/-340 to 740°F	
10	T	-199.9 to 400.0°C/-199.9 to 700.0°F	-219.9 to 420.0°C/-239.9 to 740°F	Thermocouple
11	E	-200 to 600°C/-300 to 1100°F	-220 to 620°C/-340 to 1140°F	
12	L	-100 to 850°C/-100 to 1500°F	-120 to 870°C/-140 to 1540°F	
13	U	-200 to 400°C/-300 to 700°F	-220 to 420°C/-340 to 740°F	
14	U	-199.9 to 400.0°C/-199.9 to 700.0°F	-219.9 to 420.0°C/-239.9 to 740°F	
15	N	-200 to 1300°C/-300 to 2300°F	-220 to 1320°C/-340 to 2340°F	
16	R	0 to 1700°C/0 to 3000°F	-20 to 1720°C/-40 to 3040°F	
17	S	0 to 1700°C/0 to 3000°F	-20 to 1720°C/-40 to 3040°F	
18	B	0 to 1800°C/0 to 3200°F	-20 to 1820°C/-40 to 3240°F	
19	C/W	0 to 2300°C/0 to 3200°F	-20 to 2320°C/-40 to 3240°F	
20	PLII	0 to 1300°C/0 to 2300°F	-20 to 1320°C/-40 to 2340°F	
21	Pt1000	-200 to 850°C/-300 to 1500°F	-220 to 870°C/-340 to 1540°F	Resistance thermometer
22	Pt1000	-199.9 to 500.0°C/-199.9 to 900.0°F	-219.9 to 520.0°C/-239.9 to 940.0°F	
23	Pt1000	0.0 to 100.0°C/0.0 to 210.0°F	-20.0 to 120.0°C/-40.0 to 250.0°F	

Reference Accuracy and Temperature Coefficient Table

Reference accuracies and temperature coefficients are shown below by input type and measurement temperature.


To convert the temperature Unit from Celsius to Fahrenheit, use the following equation.

Fahrenheit temperature (°F) = Celsius temperature (°C) x 1.8 + 32

Set values	Input type		Measurement temperature (°C)	Reference accuracy °C (%) *2	Temperature coefficient °C/°C *3 (ppm/°C *4)
	Sensor	Temperature range (°C) *1			
0	Pt100	-200 to 850	-200 to 300	±1.0 (±0.1%)	±0.1 (±100 ppm/°C)
			300 to 700	±2.0 (±0.2%)	±0.2 (±200 ppm/°C)
			700 to 850	±2.5 (±0.25%)	±0.25 (±250 ppm/°C)
1	Pt100	-199.9 to 500.0	-199.9 to 300.0	±0.8 (±0.12%)	±0.1 (±150 ppm/°C)
			300.0 to 500.0	±0.8 (±0.12%)	±0.2 (±300 ppm/°C)
2	Pt100	0.0 to 100.0	0.0 to 100.0	±0.8 (±0.8%)	±0.1 (±1000 ppm/°C)
3	JPt100	-199.9 to 500.0	-199.9 to 300.0	±0.8 (±0.12%)	±0.1 (±150 ppm/°C)
			300.0 to 500.0	±0.8 (±0.12%)	±0.2 (±300 ppm/°C)
4	JPt100	0.0 to 100.0	0.0 to 100.0	±0.8 (±0.8%)	±0.1 (±1000 ppm/°C)
5	K	-200 to 1300	-200 to -100	±1.5 (±0.1%)	±0.15 (±100 ppm/°C)
			-100 to 400		±0.30 (±200 ppm/°C)
			400 to 1300		±0.38 (±250 ppm/°C)
6	K	-20.0 to 500.0	-20.0 to 400.0	±1.0 (±0.2%)	±0.30 (±600 ppm/°C)
			400.0 to 500.0		±0.38 (±760 ppm/°C)
7	J	-100 to 850	-100 to 400	±1.4 (±0.15%)	±0.14 (±150 ppm/°C)
			400 to 850		±0.28 (±300 ppm/°C)
8	J	-20.0 to 400.0	-20.0 to 400.0	±1.0 (±0.24%)	±0.14 (±350 ppm/°C)
9	T	-200 to 400	-200 to -100	±1.2 (±0.2%)	±0.30 (±500 ppm/°C)
			-100 to 400		±0.12 (±200 ppm/°C)
10	T	-199.9 to 400.0	-199.9 to -100.0	±1.2 (±0.2%)	±0.30 (±500 ppm/°C)
			-100.0 to 400.0		±0.12 (±200 ppm/°C)
11	E	-200 to 600	-200 to 400	±1.2 (±0.15%)	±0.12 (±150 ppm/°C)
			400 to 600		±0.24 (±300 ppm/°C)
12	L	-100 to 850	-100 to 300	±1.1 (±0.12%)	±0.11 (±120 ppm/°C)
			300 to 700		±0.22 (±240 ppm/°C)
			700 to 850		±0.28 (±300 ppm/°C)
13	U	-200 to 400	-200 to 400	±1.2 (±0.2%)	±0.12 (±200 ppm/°C)
14	U	-199.9 to 400.0	-199.9 to 400.0	±1.2 (±0.2%)	±0.12 (±200 ppm/°C)
15	N	-200 to 1300	-200 to 400	±1.5 (±0.1%)	±0.30 (±200 ppm/°C)
			400 to 1000		±0.38 (±250 ppm/°C)
			1000 to 1300		
16	R	0 to 1700	0 to 500	±1.75 (±0.11%)	±0.44 (±260 ppm/°C)
			500 to 1200		
			1200 to 1700		
17	S	0 to 1700	0 to 1700	±2.5 (±0.15%)	±0.44 (±260 ppm/°C)
18	B	0 to 1800	0 to 400	Reference accuracy cannot be guaranteed	Reference accuracy cannot be guaranteed
			400 to 1200		
			1200 to 1800		
19	C/W	0 to 2300	0 to 300	±1.15 (±0.05%)	±0.46 (±200 ppm/°C)
			300 to 800		
			800 to 1500		
			1500 to 2300		
20	PL II	0 to 1300	0 to 400	±1.3 (±0.1%)	±0.23 (±200 ppm/°C)
			400 to 800		
			800 to 1300		
21	Pt1000	-200 to 850	-200 to 300	±1.0 (±0.1%)	±0.1 (±100 ppm/°C)
			300 to 700		
			700 to 850		
22	Pt1000	-199.9 to 500.0	-199.9 to 300.0	±0.8 (±0.12%)	±0.1 (±150 ppm/°C)
			300.0 to 500.0		
23	Pt1000	0.0 to 100.0	0.0 to 100.0	±0.8 (±0.8%)	±0.1 (±1000 ppm/°C)

*1. The decimal point position of the various input types is "no decimal point" or "decimal point 1 digit". When calculating measured value error, round up calculation results in accordance with the decimal point position of the temperature range.

*2. The overall accuracy of the Temperature Control Unit is guaranteed for a set consisting of a cold junction sensor that is mounted on the terminal block and a Temperature Control Unit. Be sure to use the terminal block and Temperature Control Unit with the same calibration control number together. For the 24mm width model, also be sure the left and right terminal blocks are correctly attached.

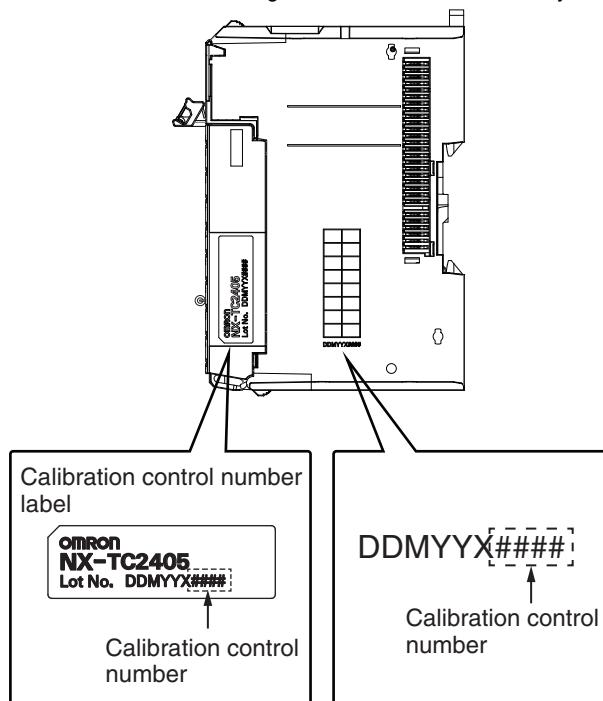

*3. An error for a measured value when the ambient temperature changes by 1°C.

The following formula is used to calculate the error of the measured value for thermocouple inputs..

Overall accuracy = Reference accuracy + Temperature characteristic x Change in the ambient temperature + Cold junction compensation error

For resistance thermometer inputs, there is no cold junction compensation error.

(Calculation example)

- Conditions

Item	Description
Ambient temperature	30°C
Measured value	100°C
Thermocouple	K: -200 to 1300°C

- The characteristic values are formulated from the datasheet or reference accuracy and temperature coefficient table under the above conditions

Item	Description
Reference accuracy	-100 to 400°C: $\pm 1.5^\circ\text{C}$
Temperature coefficient	-100 to 400°C: $\pm 0.30^\circ\text{C}/^\circ\text{C}$
Change in the ambient temperature	25°C -> 30°C 5 deg
Cold junction compensation error	$\pm 1.2^\circ\text{C}$

Therefore,

Overall accuracy = Reference accuracy + Temperature characteristic x Change in the ambient temperature +

Cold junction compensation error

$$= \pm 1.5^\circ\text{C} + (\pm 0.30^\circ\text{C}/^\circ\text{C}) \times 5 \text{ deg} + \pm 1.2^\circ\text{C}$$

$$= \pm 4.2^\circ\text{C}$$

-200 to 1300°C without decimal point. the calculation result is round up after the decimal point.

Then the overall accuracy is $\pm 5^\circ\text{C}$.

*4. The ppm value is for the full scale of the temperature range.

Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type

This section describes the cold junction compensation errors for thermocouple inputs, which differ by installation orientation of this Unit, type of adjacent Units, and current consumed by the adjacent Units.

When the Adjacent Units are Temperature Control Units

This section describes the cold junction compensation errors when the adjacent Units are Temperature Control Units. The error differs by installation orientation.

(a) For upright installation

The cold junction compensation error is $\pm 1.2^{\circ}\text{C}$.

However, there are exceptions depending on the input type and temperature. Those conditions and the cold junction compensation error are as in the table below.

Input type and temperature range	Cold junction compensation error
T below -90°C	
J, E, K and N below -100°C	$\pm 3.0^{\circ}\text{C}$
U, L and PLII	
R and S below 200°C	
B below 400°C	Not guaranteed
C/W	$\pm 3.0^{\circ}\text{C}$

(b) For other than upright installation

The cold junction compensation error is $\pm 4.0^{\circ}\text{C}$.

However, there are exceptions depending on the input type and temperature. Those conditions and the cold junction compensation error are as in the table below.

Input type and temperature range	Cold junction compensation error
T below -90°C	
J, E, K and N below -100°C	$\pm 7.0^{\circ}\text{C}$
U, L and PLII	
R and S below 200°C	
B below 400°C	Not guaranteed
C/W	$\pm 9.0^{\circ}\text{C}$

When the Adjacent Units are not Temperature Control Units

This section describes the cold junction compensation errors when the adjacent Units are not Temperature Control Units. The error differs by the installation orientation and power consumption by the adjacent Units.

(a) For upright installation, when the power consumption is 1.5 W or less for both the left and right adjacent Units

The cold junction compensation error is $\pm 1.2^{\circ}\text{C}$.

However, there are exceptions depending on the input type and temperature. Those conditions and the cold junction compensation error are as in the table below.

Input type and temperature range	Cold junction compensation error
T below -90°C	
J, E, K and N below -100°C	$\pm 3.0^{\circ}\text{C}$
U, L and PLII	
R and S below 200°C	
B below 400°C	Not guaranteed
C/W	$\pm 3.0^{\circ}\text{C}$

(b) When the power consumption of either the left or the right adjacent Unit is more than 1.5 W but less than 3.9 W.

Or for any installation other than upright, when the power consumption of both the left and right adjacent Units is less than 3.9 W

The cold junction compensation error is $\pm 4.0^{\circ}\text{C}$.

However, there are exceptions depending on the input type and temperature. Those conditions and the cold junction compensation error are as in the table below.

Input type and temperature range	Cold junction compensation error
T below -90°C	
J, E, K and N below -100°C	$\pm 7.0^{\circ}\text{C}$
U, L and PLII	
R and S below 200°C	
B below 400°C	Not guaranteed
C/W	$\pm 9.0^{\circ}\text{C}$

(c) When the power consumption exceeds 3.9 W for either the left or right adjacent Unit

Do not use the above condition (c) because the cold junction compensation error is not guaranteed in this condition.

(d) The power consumption of adjacent Units

The power consumption of adjacent Units is the total of the following values.

- The power consumption of the NX Unit power supply and I/O power supply for the NX Units adjacent to the Temperature Input Unit. If the adjacent Unit is an Input Unit, it is the total power consumption according to the input current.

Version Information

Connected to a CPU Unit

Refer to the user's manual for the CPU Unit for details on the CPU Units to which NX Units can be connected.

NX Unit		Corresponding version *1	
Model	Unit Version	CPU Unit	Sysmac Studio
NX-TC2405	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC2406	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC2407	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC2408	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC3405	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC3406	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC3407	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40
NX-TC3408	Ver.1.0		Ver.1.21
	Ver.1.1		Ver.1.22
	Ver.1.2		Ver.1.30
	Ver.1.3		Ver.1.40

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

Connected to a Communications EtherCAT Coupler Unit

NX Unit		Corresponding version *1		
Model	Unit Version	EtherCAT Coupler Unit	CPU Unit or Industrial PC	Sysmac Studio
NX-TC2405	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC2406	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC2407	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC2408	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC3405	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC3406	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC3407	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40
NX-TC3408	Ver.1.0			Ver.1.21
	Ver.1.1			Ver.1.22
	Ver.1.2			Ver.1.30
	Ver.1.3			Ver.1.40

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

*2. When you connect the Unit to a master of other manufacturer, use an EtherCAT Coupler Unit with Unit version 1.5 or later.

Connected to a Communications EtherNet/IP Coupler Unit

NX Unit		Corresponding version*1					
Model	Unit Version	Application with an NJ/NX/NY-series Controller *2			Application with an CS/CJ/CP-series PLC *3		
		EtherNet/IP Coupler Unit	CPU Unit or Industrial PC	Sysmac Studio	EtherNet/IP Coupler Unit	Sysmac Studio	NX-IO Configurator
NX-TC2405	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC2406	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC2407	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC2408	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC3405	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC3406	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC3407	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22
NX-TC3408	Ver.1.0			Ver.1.21		Ver.1.21	Ver.1.21
	Ver.1.1			Ver.1.22		Ver.1.22	Ver.1.22
	Ver.1.2			Ver.1.30		Ver.1.30	Ver.1.21
	Ver.1.3			Ver.1.40		Ver.1.40	Ver.1.22

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

*2. Refer to the user's manual of the EtherNet/IP Coupler Unit for the Unit versions of EtherNet/IP Units corresponding to EtherNet/IP Coupler Units.


*3. Refer to the user's manual of the EtherNet/IP Coupler Unit for the Unit versions of CPU Units and EtherNet/IP Units corresponding to EtherNet/IP Coupler Units.

External Interface

Temperature Control Unit


NX-TC2405/2406/2407/2408 (2 Ch Type)

12mm Width

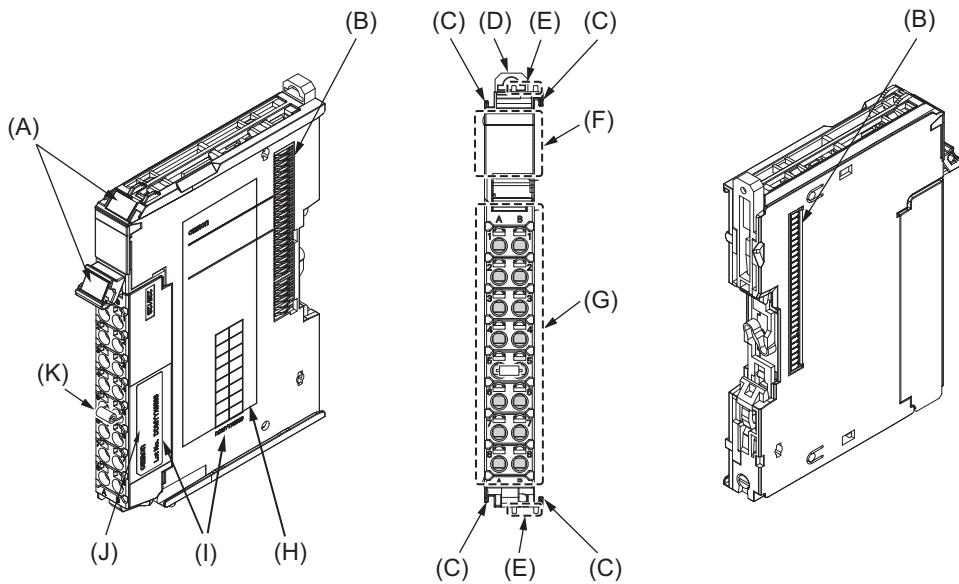


NX-TC3405/3406/3407/3408 (4 Ch Type)

24mm Width

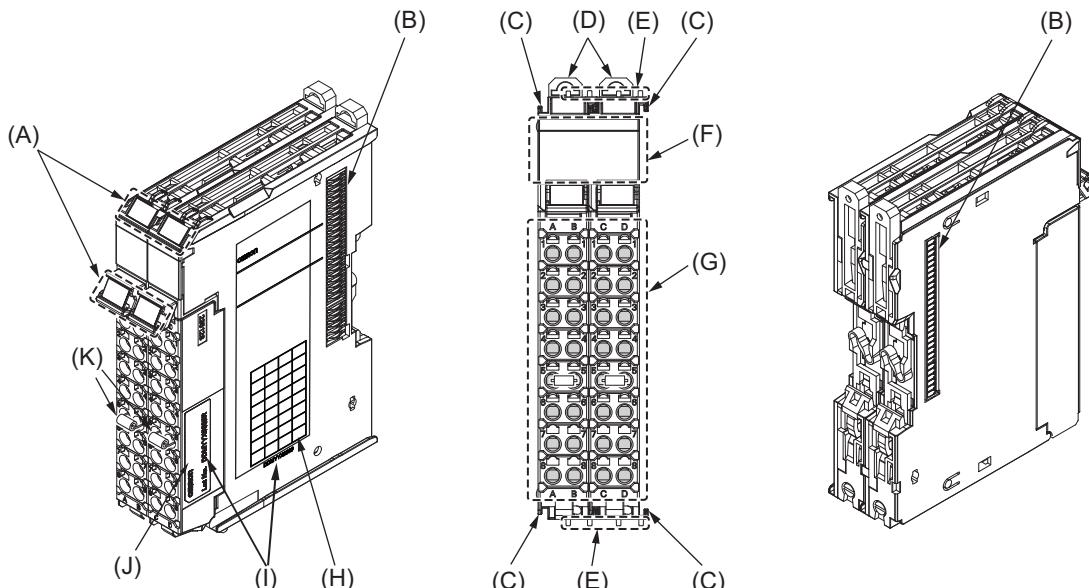

Letter	Item	Specification
(A)	Marker attachment locations	The locations where markers are attached. The markers made by OMRON are installed for the factory setting. Commercially available markers can also be installed.
(B)	NX bus connector	This connector is used to connect each Unit.
(C)	Unit hookup guides	These guides are used to connect two Units.
(D)	DIN Track mounting hooks	These hooks are used to mount the NX Unit to a DIN Track.
(E)	Protrusions for removing the Unit	The protrusions to hold when removing the Unit.
(F)	Indicators	The indicators show the current operating status of the Unit.
(G)	Terminal block	The terminal block is used to connect external devices. The number of terminals depends on the type of Unit.
(H)	Unit specifications	The specifications of the Unit are given.
(I)	Calibration control number	The calibration control number is used to guarantee overall accuracy. The overall accuracy is guaranteed by using the terminal block and the Unit as a set that have the same calibration control number.
(J)	Calibration control number label	The label attached on the terminal block with a calibration control number written on it. With 24 mm wide models, the labels are attached on both left and right terminal blocks. "L" or "R" is appended at the end of the calibration control number to identify left or right.
(K)	Cold junction sensor	This sensor is used to perform the cold junction compensation. The sensors are mounted on both left and right terminal blocks for models with 24 mm width.

Terminal Blocks

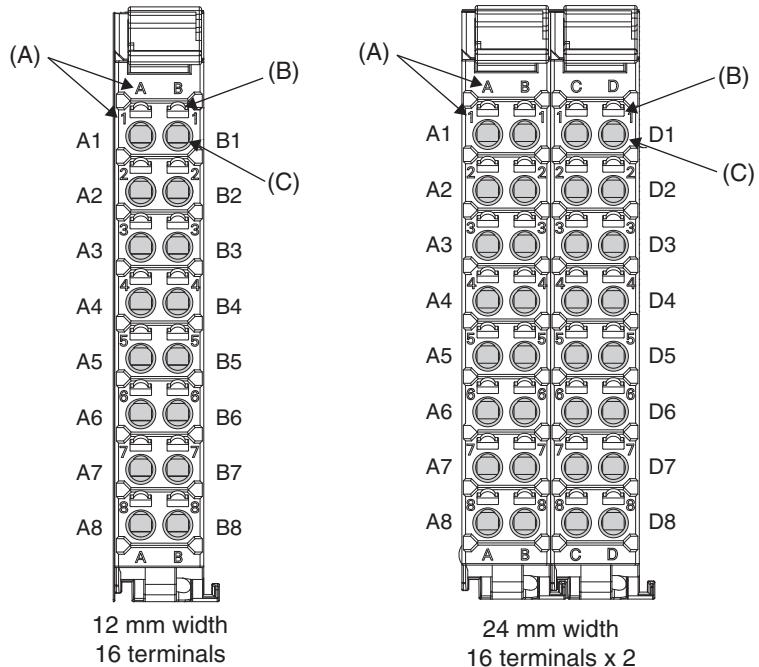

Letter	Item	Specification
(A)	Terminal number indications	Terminal numbers for which A to D indicate the column, and 1 to 8 indicate the line are displayed. The terminal number is a combination of column and line, i.e. A1 to A8 and B1 to B8. For models of 24 mm width, A1 to A8 and B1 to B8 are terminal numbers of the left terminal block, C1 to C8 and D1 to D8 are terminal numbers of the right terminal block. The terminal number indications are the same regardless of the number of terminals on the terminal block.
(B)	Release holes	Insert a flat-blade screwdriver into these holes to connect and remove the wires.
(C)	Terminal holes	The wires are inserted into these holes.

Applicable Wires

Using Ferrules

If you use ferrules, attach the twisted wires to them.

Observe the application instructions for your ferrules for the wire stripping length when attaching ferrules.

Always use plated one-pin ferrules. Do not use unplated ferrules or two-pin ferrules.


The applicable ferrules, wires, and crimping tool are given in the following table.

Terminal type	Manufacturer	Ferrule model	Applicable wire (mm ² (AWG))	Crimping tool
Terminals other than ground terminals	Phoenix Contact	AI0,34-8	0.34 (#22)	Phoenix Contact (The figure in parentheses is the applicable wire size.) CRIMPFOX 6 (0.25 to 6 mm ² , AWG24 to 10)
		AI0,5-8	0.5 (#20)	
		AI0,5-10		
		AI0,75-8	0.75 (#18)	
		AI0,75-10		
		AI1,0-8	1.0 (#18)	
		AI1,0-10		
		AI1,5-8	1.5 (#16)	
		AI1,5-10		
		AI2,5-10	2.0 *	
Ground terminals	Weidmuller	H0.14/12	0.14 (#26)	Weidmuller (The figure in parentheses is the applicable wire size.) PZ6 Roto (0.14 to 6 mm ² , AWG 26 to 10)
		H0.25/12	0.25 (#24)	
		H0.34/12	0.34 (#22)	
		H0.5/14	0.5 (#20)	
		H0.5/16		
		H0.75/14	0.75 (#18)	
		H0.75/16		
		H1.0/14	1.0 (#18)	
		H1.0/16		
		H1.5/14	1.5 (#16)	
		H1.5/16		

* Some AWG 14 wires exceed 2.0 mm² and cannot be used in the screwless clamping terminal block.

When you use any ferrules other than those in the above table, crimp them to the twisted wires so that the following processed dimensions are achieved.

Finished Dimensions of Ferrules

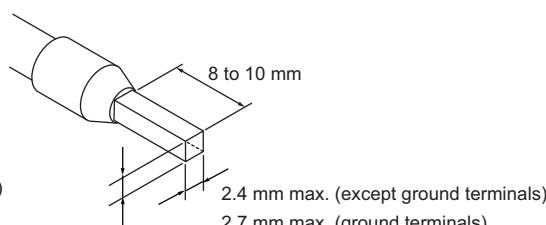


Using Twisted Wires/Solid Wires

If you use the twisted wires or the solid wires, use the following table to determine the correct wire specifications.

Terminals		Wire type				Wire size	Conductor length (stripping length)
		Twisted wires		Solid wire			
Classification	Current capacity	Plated	Unplated	Plated	Unplated		
All terminals except ground terminals	2 A or less	Possible	Possible	Possible	Possible	0.08 to 1.5 mm ² AWG28 to 16	8 to 10 mm
	Greater than 2 A and 4 A or less		Not Possible	Possible *1	Not Possible		
	Greater than 4 A		Possible *1	Not Possible	Not Possible		
Ground terminals	---	Possible	Possible	Possible *2	Possible *2	2.0 mm ²	9 to 10 mm

*1. Secure wires to the screwless clamping terminal block. Refer to the Securing Wires in the USER'S MANUAL for how to secure wires.

*2. With the NX-TB□□□1 Terminal Block, use twisted wires to connect the ground terminal. Do not use a solid wire.





Conductor length (stripping length)

Note: <Additional Information> If more than 2 A will flow on the wires, use plated wires or use ferrules.

Dimensions

(Unit/mm)

Temperature Control Unit

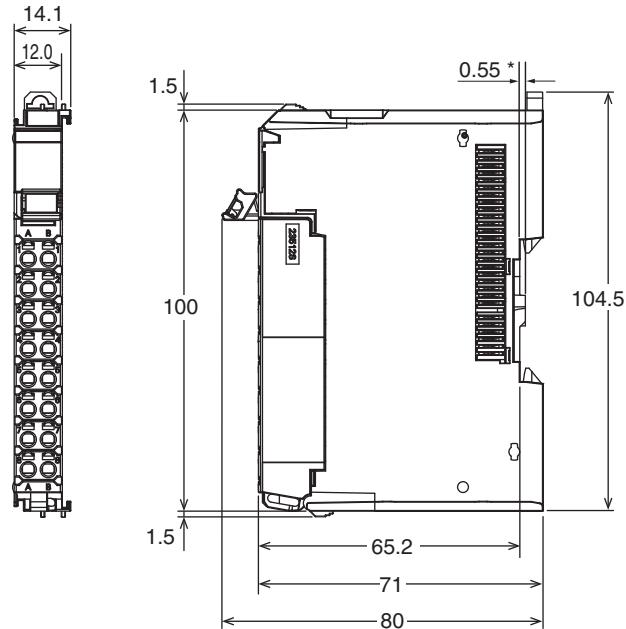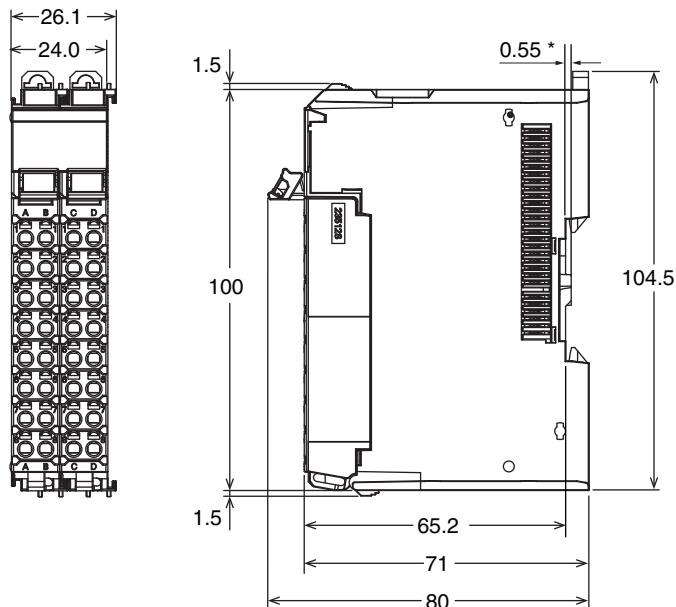NX-TC2405/2406/2407/2408 (2 Ch type)
12 mm WidthNX-TC3405/3406/3407/3408 (4 Ch type)
24 mm Width

Related Manual

Cat. No.	Model number	Manual name	Application	Description
H228	NX-TC□□□□	NX-series User's Manual Temperature Control Units	Learning how to use NX-series Temperature Control Units	The hardware, setup methods, and functions of the NX-series Temperature Control Units are described.

NX-series Advanced Temperature Control Units

NX-HTC

NX-HTC

NX-HTC

Combining Space-Saving Design and Advanced Temperature Controllability

- Capable of controlling up to 8 loops (channels) in 30 mm width.
- Corresponds to a resolution of 0.01°C.
(Thermocouple K: -50.00 to 700.00°C,
Pt100: -200.00 to 500.00°C)
- Features the ability to detect variations in temperature profiles caused by unpredictable disturbances.
(Feature Visualization)
- Features the ability to suppress temperature variations caused by regular disturbances. (Disturbance Suppression)



NX-HTC-3510-5



NX-HTC-4505-5

Features

- Build-in 4-or 8-loop (Ch) PID control or ON/OFF control functions not required temperature control programming
- With heater burnout alarm is available
- Available with universal inputs: thermocouple input, platinum resistance thermometer input and analog input
- Reduces man-hours for wiring by using an Connector-Terminal Block Conversion Unit


Sysmac is a trademark or registered trademark of OMRON Corporation in Japan and other countries for OMRON factory automation products. EtherCAT® is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany. EtherNet/IP™ is a trademark of ODVA.

Other company names and product names in this document are the trademarks or registered trademarks of their respective companies.

System Configurations


Connected to a CPU Unit

The following figure shows a system configuration when NX Units are connected to an NX-series CPU Unit.

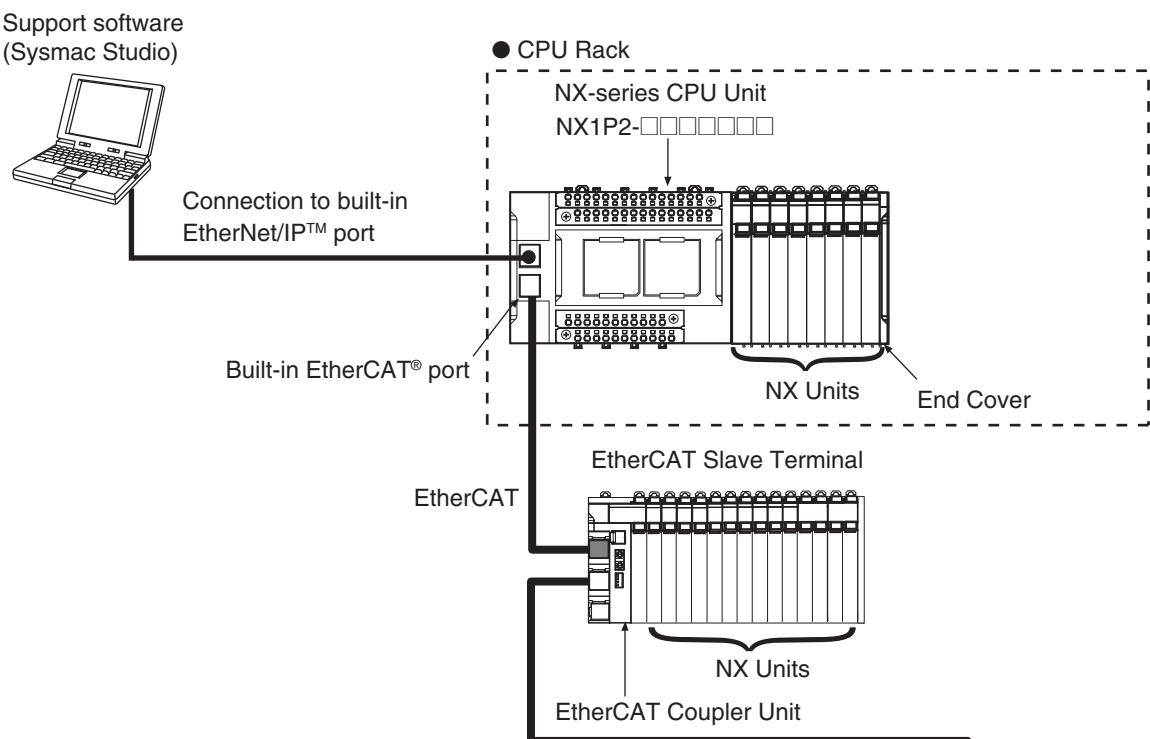

Connected to an EtherCAT Coupler Unit


The following figure shows an example of the system configuration when an EtherCAT Coupler Unit is used as a Communications Coupler Unit.

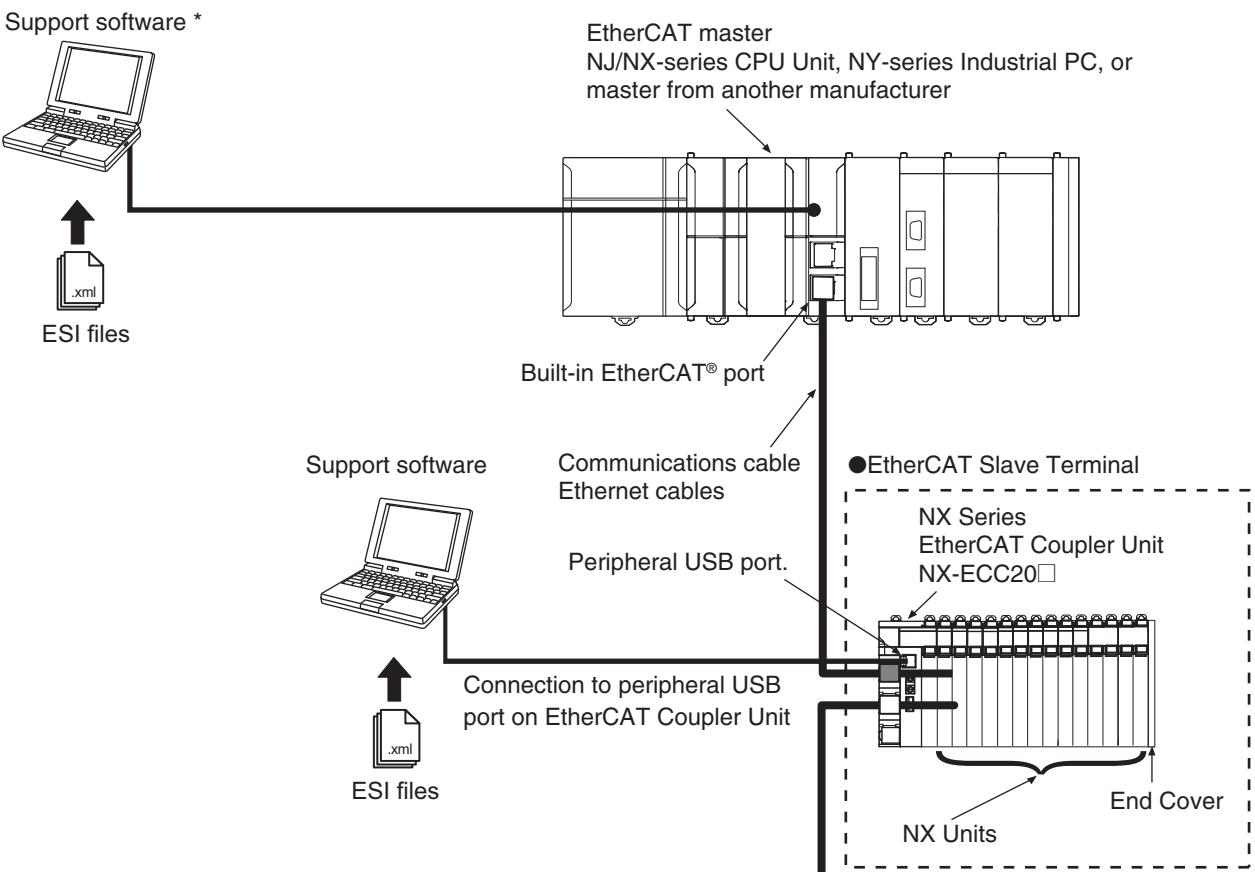

* The connection method for the Sysmac Studio depends on the model of the CPU Unit or Industrial PC.

Note: To check whether NX Units can be connected to your CPU Unit or Communications Coupler Unit, refer to the user's manual for the CPU Unit or Communications Coupler Unit.

Model Number Structure

NX-HTC 

N
X
·
T
C

N
X
·
H
T
C

(1) Number of points

No.	Specification
3	4 points
4	8 points

(2) I/O type

No.	Sensor type
5	Universal inputs (thermocouple, platinum resistance thermometer, analog voltage, analog current)

(3) I/O type

No.	Control	Output		Number of CT input points per channel	I/O Refreshing Methods
		Output	Number of output points per channel		
05	Standard control	Voltage output (for driving SSR)	1 point per channel	1 point per channel	Free-Run refreshing
10	Heating/cooling control	Voltage output (for driving SSR)	1 point per channel	1 point per channel	
		Linear current output	1 point per channel		

(4) External connection terminal

No.	External connection terminal
5	MIL connector

Ordering Information

Applicable standards

Refer to the OMRON website (www.ia.omron.com) or ask your OMRON representative for the most recent applicable standards for each model.

Advanced Temperature Control Units

Unit type	Product name	Specification								Model
		Number of channels	Input type	Output	Output capacity	CT Input capacity	Control type	Conversion time	I/O refreshing method	
NX Series Advanced Temperature Control Units	Advanced Temperature Control Units 4Ch type	4 Ch	Universal inputs (thermocouple, platinum resistance thermometer, analog voltage, analog current)	Voltage output (for driving SSR)	4 points	4 points	Heating and Cooling Control	50 m sec	Free-Run refreshing	NX-HTC3510-5
	Advanced Temperature Control Units 8Ch type			Linear current output						
		8 Ch		Voltage output (for driving SSR)	8 points	8 points	Standard Control			NX-HTC4505-5

Optional Products

Product name	Specification	Model
Cold Junction Sensor	For NX-HTC only *1	NX-AUX03

*1. The cold junction sensor is included in NX-HTC and cannot be used for NX-TC.
Make a purchase only when the sensor is damaged or lost.

Product name	Specification	Model
Current Transformer (CT)	Hole diameter: 5.8 mm	E54-CT1
	Hole diameter: 5.8 mm	E54-CT1L *2
	Hole diameter: 12.0 mm	E54-CT3
	Hole diameter: 12.0 mm	E54-CT3L *2

*2. Lead wires are included with these CTs. If UL certification is required, use these CTs.

Accessories

Cold Junction Sensor (NX-AUX03)

One cold junction sensor is included in each Advanced Temperature Control Unit.

General Specifications

Item	Specification
Enclosure	Mounted in a panel
Grounding method	Ground to 100 Ω or less
Operating environment	Ambient operating temperature 0 to 55°C
	Ambient operating humidity 10 to 95% (with no condensation or icing)
	Atmosphere Must be free from corrosive gases.
	Ambient storage temperature -25 to 70°C (with no condensation or icing)
	Altitude 2,000 m max.
	Pollution degree Pollution degree 2 or less: Conforms to IEC 61010-2-201.
	Noise immunity Conforms to IEC 61000-4-4, 2 kV (power supply line)
	Overvoltage category Category II: Conforms to IEC 61010-2-201.
	EMC immunity level Zone B
	Vibration resistance Conforms to IEC 60068-2-6. 5 to 8.4 Hz with amplitude of 3.5 mm, 8.4 to 150 Hz, acceleration of 9.8 m/s ² 100 min each in X, Y, and Z directions (10 sweeps of 10 min each = 100 min total)
	Shock resistance Conforms to IEC 60068-2-27. 147 m/s ² , 3 times each in X, Y, and Z directions
	Insulation resistance Refer to individual specifications of each NX Unit.
	Dielectric strength Refer to individual specifications of each NX Unit.
Applicable standards *	cULus: Listed (UL 61010-2-201), UL121201, EU: EN 61131-2, RCM, KC: KC Registration, UKCA

* Refer to the OMRON website (www.ia.omron.com) or ask your OMRON representative for the most recent applicable standards for each model.

N
X
-
T
CN
X
-
H
T
C

List of Functions

Function name	Description	Applicable Units
Free-Run Refreshing	With this I/O refreshing method, the refresh cycle of the NX bus and the I/O refresh cycles of the NX Units are asynchronous.	All models
Selecting Channel To Use	This function disables control processing, error detection, and output for unused channels. The conversion time for its own Unit will not be shortened even if errors are disabled.	All models
Input Functions	Input Type Setting	This function sets the following input type of sensor input which is connected to the temperature input. Thermocouple, platinum resistance thermometer, or analog (current: 4 to 20 mA / 0 to 20 mA, voltage: 1 to 5 V / 0 to 5 V / 0 to 10 V)
	Temperature Unit Setting (°C/°F)	This function sets the temperature units for measured values to °C (Celsius) or °F (Fahrenheit).
	Decimal Point Position Setting	This function sets the number of digits displayed after the decimal point for INT type parameters of measured values, set points and alarm values (including alarm upper / lower limits). If the decimal point position for the above-mentioned parameters is fixed in a host device, design changes concerning the decimal point position can be absorbed when replacing a third-party temperature control Unit.
	Cold Junction Compensation Enable/Disable Setting	This function enables or disables cold junction compensation using the cold junction sensor that is mounted on the terminal block when a thermocouple input is used.
	Temperature Input Correction	This function corrects measured values. When there are variations in the sensor or when there is a difference in measured value from other measuring instruments. One-point correction and two-point correction methods are provided.
	Input Digital Filter	This function sets the time constant applied to the first-order lag operation filter so that the noise components mixed with the measured value are eliminated.
	Measuring the Ambient Temperature Around Terminals	This function measures the temperature around the terminals of the Advanced Temperature Control Unit.
Control Processing	Analog Input Setting	This function is for analog input and sets the scaling to use the physical analog quantities of current and voltage as inputs for the control application.
	ON/OFF Control	This control function uses a preset set point to turn off the control output when the temperature reaches the set point during control.
	PID Control	PID control is a combination of proportional (P) control, integral (I) control, and differential (D) control. It is a control function that feeds back the detected value to the set point so that they conform to each other.
	Heating/Cooling Control	This function controls both heating and cooling.
	Run or Stop Controls	This function starts and stops temperature control.
	Direct/Reverse Operation	This function specifies direct or reverse operation.
	Manual MV (Manual Manipulated Variable)	This function outputs the specified manipulated variable during PID control.
	MV at Error	This function outputs a fixed manipulated variable when a Sensor Disconnected Error occurs.
	MV Limit	This function adds a limit to the manipulated variable calculated by PID control and outputs it.
	Load Rejection MV	The load rejection means that the connection to the Advanced Temperature Control Unit is interrupted due to a communications error between the CPU Unit and the Communications Coupler Unit host or due to an error on the NX bus. This function performs a preset output operation if any of the following problems occur. - The Advanced Temperature Control Unit connected to the CPU Unit cannot receive the output setting values from the CPU Unit due to an NX bus error or CPU watchdog timer error. - The Slave Terminal cannot receive the output setting values due to a communications error between the Advanced Temperature Control Unit and the Communications Coupler Unit host or due to an error on the NX bus.
Control Processing	Load Short-circuit Protection	The load short-circuit means that an external device (SSR) connected to the voltage output (for driving SSR) of the Advanced Temperature Control Unit is shortcircuited. The load short-circuit protection is a function of the Advanced Temperature Control Unit with voltage output (for driving SSR), which protects output circuits of the Advanced Temperature Control Unit when an external device (SSR) connected to the voltage output (for driving SSR) is shortcircuited.
	MV Branch	The manipulated variables calculated by the slope or offset are output to the branch-destination channel based on the manipulated variables of the branch-source channel.
	Disturbance Suppression (Pre-boost)	This function suppresses temperature variations by adding a preset manipulated variable before temperature variations occur due to a disturbance.

Function name		Description	Applicable Units
Tuning	AT (Autotuning)	This is a tuning method that derives the PID constant. This function automatically calculates the PID constant by the limit cycle method according to the characteristics of the control target.	All models
	D-AT (Disturbance Autotuning)	This function automatically calculates disturbance suppression (Pre-boost) function parameters such as FF waiting time, FF operation time, and FF segments 1 to 4 manipulated variables.	Standard control type models
Control Output	Control Period	This function sets the period when the ON/OFF time ratio is changed for voltage output (for driving SSR) in time-proportional operation.	Models with voltage output (for driving SSR)
	Minimum Output ON/OFF Band	This function specifies the minimum ON/OFF bands for the heating side control output or the cooling side control output. This function can be used to prevent deterioration of mechanical relays when mechanical relays are used in the actuators connected to the output terminals.	Models with voltage output (for driving SSR)
	Output Signal Range Setting	This function sets the output signal range of the linear current output. You can specify 4 to 20 mA or 0 to 20 mA.	Models with linear current output
Error Detection	Temperature Alarms	Function for detecting a deviation or an error in the measured value as an alarm. Alarm operation corresponding to the use can be performed by selecting "Alarm type".	All models
	LBA (Loop Burnout Alarm)	Function for detecting, as an alarm, the error location in the control loop when there is no change in the measured value while a control deviation equal to or more than the threshold value exists between the set point and the measured value. This function can be used only for temperature input.	All models
	Sensor Disconnection Detection	This function detects disconnections in temperature sensors. It also detects that the measured value of the temperature sensor is outside the input indication range.	All models
	Heater Burnout Detection	This function detects heater burnouts. A heater burnout is detected if the control output is ON and the heater current is equal to or less than the heater burnout detection current.	Models with CT input
	SSR Failure Detection	This function detects SSR failures. An SSR failure is detected if the control output is OFF and the leakage current is equal to or greater than the SSR failure detection current. An SSR failure is a failure that is caused by an SSR short-circuit.	Models with CT input
Predictive maintenance	Feature Visualization	This function enables monitoring of features (as feature data) appearing in the control waveform of set point and disturbance responses.	All models

Individual Specifications

Advanced Temperature Control Units (4-Channel Type) NX-HTC3510-5

Unit name	Advanced Temperature Control Units (4-Channel Type)	Model	NX-HTC3510-5
Number of Channels	4 channels	Control type	Heating and cooling control
Number of points per channel	<ul style="list-style-type: none"> Universal inputs: 1 point per channel (4 points per Unit) CT Input: 1 point per channel (4 points per Unit) Control Output: 2 points per channel (8 points per Unit) 	External connection terminal	MIL connector 34 poles, 2 rows *4
I/O refreshing method	Free-Run Refreshing		
Indicators	<p>TS indicator and output indicators</p> <p>HTC3510-5 </p> <p>1 2 3 4 5 6 7 8</p>	CT Input section	
Sensor Input section	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire) Analog input Current: 4 to 20 mA, 0 to 20 mA Voltage: 1 to 5 V, 0 to 5 V, 0 to 10 V 	Common	CT current input range 0 to 0.125 A Input resistance Approx. 2.7 Ω Connectable CTs E54-CT1, E54-CT3, E54-CT1L, and E54-CT3L Maximum heater current 50 A AC Resolution 0.1 A Overall accuracy (25°C) ±5% (full scale) ±1 digit Influence of temperature (0 to 55°C) ±2% (full scale) ±1 digit Conversion time 50 ms per Unit
	<ul style="list-style-type: none"> Thermocouple input: 20 Ω min. Analog voltage input: 1 MΩ min. Analog current input: 150 Ω max. 		Control output type and number of control outputs per channel Voltage output for driving SSR, 1 point per channel Linear current output, 1 point per channel Number of control output Methods points 8 (heating: 4, cooling: 4) Manipulated variable -105 to +105% Rated Voltage 24 VDC Operating Load Voltage Range 12 to 28.8 VDC
	<ul style="list-style-type: none"> 0.01°C max. (Thermocouple K (input type): -50 to 700°C and Pt100: -200 to 500°C only) 0.1°C max. (except for the above-mentioned) 		Internal I/O common PNP Control Period 0.1, 0.2, 0.5, 1 to 99s Maximum load current 21 mA per point, 84 mA per Unit Maximum Inrush Current 0.3 A max. per point, 10 ms max. Leakage current 0.1 mA max. Residual voltage 1.5 V max. Load Short-circuit Protection Provided
	<ul style="list-style-type: none"> 0.01°C max. (Thermocouple K (input type): -50 to 700°C and Pt100: -200 to 500°C only) 0.1°C max. (except for the above-mentioned) 		Allowable load resistance 350 Ω max. Resolution 1/10,000 Output range 0 to 20 mA 4 to 20 mA Overall accuracy (25°C) ±0.3% of full scale, but 1% of full scale at 0 to 4 mA of 0 to 20 mA range Influence of temperature (0 to 55°C) ±0.3% (full scale)
	30 minutes		<ul style="list-style-type: none"> Between sensor inputs and internal circuitry: Power = Transformer, Signal = Digital isolator Between sensor inputs: Power = Transformer, Signal = Digital isolator No isolation between internal circuits and CT inputs Between control output and internal circuit: Photocoupler (voltage output), digital isolator (linear current output) No isolation between control outputs
	50 ms per Unit		
Dimensions	30 mm (W) × 100 mm (H) × 71 mm (D)	Isolation method	
Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal

NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.55 W max. Connected to Communications Coupler Unit 1.35 W max. 	Current consumption from I/O power supply	30 mA max.																																																																																																																																																
Weight	125 g max.																																																																																																																																																		
Circuit configuration																																																																																																																																																			
Installation orientation and restrictions			<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error varies according to the input type. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 49.</p>																																																																																																																																																
Terminal connection diagram *5			<table border="1"> <caption>CN1</caption> <tr><td>NC</td><td>34</td><td>33</td><td>NC</td></tr> <tr><td>NC</td><td>32</td><td>31</td><td>NC</td></tr> <tr><td>NC</td><td>30</td><td>29</td><td>NC</td></tr> <tr><td>NC</td><td>28</td><td>27</td><td>NC</td></tr> <tr><td>NC</td><td>26</td><td>25</td><td>NC</td></tr> <tr><td>NC</td><td>24</td><td>23</td><td>NC</td></tr> <tr><td>NC</td><td>22</td><td>21</td><td>NC</td></tr> <tr><td>NC</td><td>20</td><td>19</td><td>NC</td></tr> <tr><td>NC</td><td>18</td><td>17</td><td>NC</td></tr> <tr><td>CJ(A)</td><td>16</td><td>15</td><td>CJ(B)</td></tr> <tr><td>NC</td><td>14</td><td>13</td><td>CJ(B)</td></tr> <tr><td>B4/TC4(+)/V4(+)</td><td>12</td><td>11</td><td>B3/TC3(+)/V3(+)</td></tr> <tr><td>B4/TC4(-)/V4(-)</td><td>10</td><td>9</td><td>B3/TC3(-)/V3(-)/I3(-)</td></tr> <tr><td>A4/I4(+)</td><td>8</td><td>7</td><td>A3/I3(+)</td></tr> <tr><td>B2/TC2(+)/V2(+)</td><td>6</td><td>5</td><td>B1/TC1(+)/V1(+)</td></tr> <tr><td>B2/TC2(-)/V2(-)</td><td>4</td><td>3</td><td>B1/TC1(-)/V1(-)/I1(-)</td></tr> <tr><td>A2/I2(+)</td><td>2</td><td>1</td><td>A1/I1(+)</td></tr> </table> <table border="1"> <caption>CN2</caption> <tr><td>CT</td><td>1</td><td>2</td><td>CT1</td></tr> <tr><td>CT2</td><td>3</td><td>4</td><td>CT2</td></tr> <tr><td>CT3</td><td>5</td><td>6</td><td>CT3</td></tr> <tr><td>CT4</td><td>7</td><td>8</td><td>CT4</td></tr> <tr><td>NC</td><td>9</td><td>10</td><td>NC</td></tr> <tr><td>NC</td><td>11</td><td>12</td><td>NC</td></tr> <tr><td>NC</td><td>13</td><td>14</td><td>NC</td></tr> <tr><td>NC</td><td>15</td><td>16</td><td>NC</td></tr> <tr><td>OUT1</td><td>17</td><td>18</td><td>NC</td></tr> <tr><td>OUT2</td><td>19</td><td>20</td><td>IOG1</td></tr> <tr><td>OUT3</td><td>21</td><td>22</td><td>IOG2</td></tr> <tr><td>OUT4</td><td>23</td><td>24</td><td>IOG3</td></tr> <tr><td>OUT5</td><td>25</td><td>26</td><td>IOG4</td></tr> <tr><td>OUT6</td><td>27</td><td>28</td><td>IOG5</td></tr> <tr><td>OUT7</td><td>29</td><td>30</td><td>IOG6</td></tr> <tr><td>OUT8</td><td>31</td><td>32</td><td>IOG7</td></tr> <tr><td></td><td>33</td><td>34</td><td>IOG8</td></tr> <tr><td></td><td></td><td></td><td>Current input</td></tr> <tr><td></td><td></td><td></td><td>SSR</td></tr> </table>	NC	34	33	NC	NC	32	31	NC	NC	30	29	NC	NC	28	27	NC	NC	26	25	NC	NC	24	23	NC	NC	22	21	NC	NC	20	19	NC	NC	18	17	NC	CJ(A)	16	15	CJ(B)	NC	14	13	CJ(B)	B4/TC4(+)/V4(+)	12	11	B3/TC3(+)/V3(+)	B4/TC4(-)/V4(-)	10	9	B3/TC3(-)/V3(-)/I3(-)	A4/I4(+)	8	7	A3/I3(+)	B2/TC2(+)/V2(+)	6	5	B1/TC1(+)/V1(+)	B2/TC2(-)/V2(-)	4	3	B1/TC1(-)/V1(-)/I1(-)	A2/I2(+)	2	1	A1/I1(+)	CT	1	2	CT1	CT2	3	4	CT2	CT3	5	6	CT3	CT4	7	8	CT4	NC	9	10	NC	NC	11	12	NC	NC	13	14	NC	NC	15	16	NC	OUT1	17	18	NC	OUT2	19	20	IOG1	OUT3	21	22	IOG2	OUT4	23	24	IOG3	OUT5	25	26	IOG4	OUT6	27	28	IOG5	OUT7	29	30	IOG6	OUT8	31	32	IOG7		33	34	IOG8				Current input				SSR
NC	34	33	NC																																																																																																																																																
NC	32	31	NC																																																																																																																																																
NC	30	29	NC																																																																																																																																																
NC	28	27	NC																																																																																																																																																
NC	26	25	NC																																																																																																																																																
NC	24	23	NC																																																																																																																																																
NC	22	21	NC																																																																																																																																																
NC	20	19	NC																																																																																																																																																
NC	18	17	NC																																																																																																																																																
CJ(A)	16	15	CJ(B)																																																																																																																																																
NC	14	13	CJ(B)																																																																																																																																																
B4/TC4(+)/V4(+)	12	11	B3/TC3(+)/V3(+)																																																																																																																																																
B4/TC4(-)/V4(-)	10	9	B3/TC3(-)/V3(-)/I3(-)																																																																																																																																																
A4/I4(+)	8	7	A3/I3(+)																																																																																																																																																
B2/TC2(+)/V2(+)	6	5	B1/TC1(+)/V1(+)																																																																																																																																																
B2/TC2(-)/V2(-)	4	3	B1/TC1(-)/V1(-)/I1(-)																																																																																																																																																
A2/I2(+)	2	1	A1/I1(+)																																																																																																																																																
CT	1	2	CT1																																																																																																																																																
CT2	3	4	CT2																																																																																																																																																
CT3	5	6	CT3																																																																																																																																																
CT4	7	8	CT4																																																																																																																																																
NC	9	10	NC																																																																																																																																																
NC	11	12	NC																																																																																																																																																
NC	13	14	NC																																																																																																																																																
NC	15	16	NC																																																																																																																																																
OUT1	17	18	NC																																																																																																																																																
OUT2	19	20	IOG1																																																																																																																																																
OUT3	21	22	IOG2																																																																																																																																																
OUT4	23	24	IOG3																																																																																																																																																
OUT5	25	26	IOG4																																																																																																																																																
OUT6	27	28	IOG5																																																																																																																																																
OUT7	29	30	IOG6																																																																																																																																																
OUT8	31	32	IOG7																																																																																																																																																
	33	34	IOG8																																																																																																																																																
			Current input																																																																																																																																																
			SSR																																																																																																																																																

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 46.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 47.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 49.

*4. Make sure you use an Connector-Terminal Block Conversion Unit to route the sensor input side.



The recommended Connector-Terminal Block Conversion Unit is XW2K-34G-T and its dedicated connecting cable is XW2Z-□□□ EE.

*5. The cold junction sensor used for cold junction compensation is provided with the Advanced Temperature Control Unit. (The sensor is not premounted on the Unit.) Make sure you connect the cold junction sensor to the Ultra-Compact Interface Wiring System (XW2K-34G-T) before using the Advanced Temperature Control Unit.

Advanced Temperature Control Units (8-Channel Type) NX-HTC4505-5

Unit name	Advanced Temperature Control Units (8-Channel Type)	Model	NX-HTC4505-5				
Number of Channels	8 channels	Control type	Standard control				
Number of points per channel	<ul style="list-style-type: none"> Universal inputs: 1 point per channel (8 points per Unit) CT Input: 1 point per channel (8 points per Unit) Control Output: 1 point per channel (8 points per Unit) 	External connection terminal	MIL connector 34 poles, 2 rows *4				
I/O refreshing method	Free-Run Refreshing						
Indicators	<p>TS indicator and output indicators</p> 	CT Input section	CT current input range	0 to 0.125 A			
			Input resistance	Approx. 2.7 Ω			
			Connectable CTs	E54-CT1, E54-CT3, E54-CT1L, and E54-CT3L			
			Maximum heater current	50 A AC			
			Resolution	0.1 A			
			Overall accuracy (25°C)	±5% (full scale) ±1 digit			
			Influence of temperature (0 to 55°C)	±2% (full scale) ±1 digit			
			Conversion time	50 ms per Unit			
Sensor Input section	Sensor type *1	<ul style="list-style-type: none"> Thermocouple input: K, J, T, E, L, U, N, R, S, B, C/W, PL II Platinum resistance thermometer input: Pt100 (three-wire), JPt100 (three-wire) Analog input Current: 4 to 20 mA, 0 to 20 mA Voltage: 1 to 5 V, 0 to 5 V, 0 to 10 V 	Common	Control output type and number of control outputs per channel	Voltage output for driving SSR, 1 point per channel		
	Input impedance			Number of control output Methods points	8		
	Resolution			Manipulated variable	-5 to +105%		
	Reference accuracy			Rated Voltage	24 VDC		
	Temperature coefficient		Control Output section	Internal I/O common	PNP		
	Cold junction compensation error			Control Period	0.1, 0.2, 0.5, 1 to 99s		
	Input disconnection detection current			Maximum load current	21 mA per point, 168 mA per Unit		
	Input detection current			Maximum Inrush Current	0.3 A max. per point, 10 ms max.		
	Effect of conductor resistance			Leakage current	0.1 mA max.		
	Warm-up period			Residual voltage	1.5 V max.		
	Conversion time			Load Short-circuit Protection	Provided		
Dimensions	30 mm (W) × 100 mm (H) × 71 mm (D)	Isolation method	Allowable load resistance	---			

Insulation resistance	20 MΩ min. between isolated circuits (at 100 VDC)	Dielectric strength	510 VAC between isolated circuits for 1 minute with a leakage current of 5 mA max.				
I/O power supply method	Supplied from the NX bus.	Current capacity of I/O power supply terminals	IOG: 0.1 A max. per terminal				

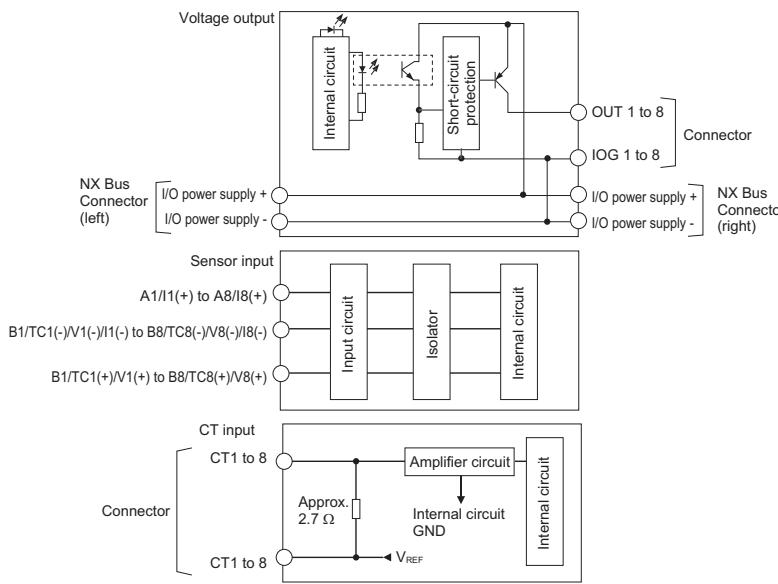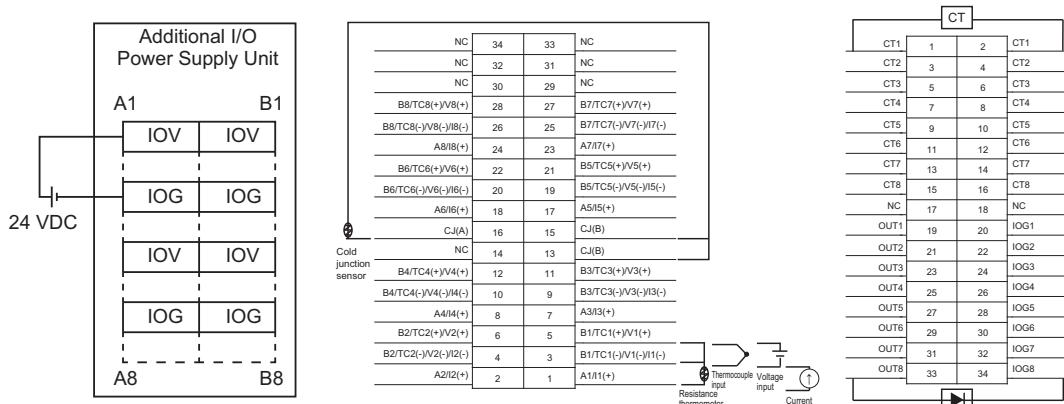NX Unit power consumption	<ul style="list-style-type: none"> Connected to a CPU Unit 1.95 W max. Connected to Communications Coupler Unit 1.65 W max. 	Current consumption from I/O power supply	20 mA max.
Weight	130 g max.		
Circuit configuration			
Installation orientation and restrictions	<p>Mounting orientation:</p> <ul style="list-style-type: none"> Connect to CPU Unit Front mounting orientation is possible Connect to Communications Coupler Unit Six orientations are possible <p>Limitation:</p> <p>The cold junction compensation error varies according to the input type. For details, refer to <i>Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type</i> on page 49.</p>		
Terminal connection diagram *5			

*1. For the setting ranges and indication ranges of the sensors, refer to the *Input types* on page 46.

*2. For details, refer to the *Reference Accuracy and Temperature Coefficient Table* on page 47.

*3. For details, refer to *Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type* on page 49.

*4. Make sure you use an Connector-Terminal Block Conversion Unit to route the sensor input side.

The recommended Connector-Terminal Block Conversion Unit is XW2K-34G-T and its dedicated connecting cable is XW2Z-□□□ EE.

*5. The cold junction sensor used for cold junction compensation is provided with the Advanced Temperature Control Unit. (The sensor is not premounted on the Unit.) Make sure you connect the cold junction sensor to the Ultra-Compact Interface Wiring System (XW2K-34G-T) before using the Advanced Temperature Control Unit.

Input types

The settings are shown in the following table.

Setting name *1	Display of support software	Description	Default	Setting range	Unit	Change application timing
Ch□ input type	Ch□ Input Type	Sets the input type.	0: Pt100 -200.00 to 500.00°C	Refer to the table below.	No	After Unit restart

*1. □ represents the channel number.

Set values	Input types		Input indication range	Remarks
	Sensor	Input setting range		
0	Pt100	-200.00 to 500.00°C/-300.00 to 920.00°F	-220.00 to 520.00°C/-420.00 to 960.00°F *1	Resistance thermometer
1	Pt100	-200.0 to 850.0°C/-300.0 to 1500.0°F	-220.0 to 870.0°C/-340.0 to 1540.0°F	
2	JPt100	-199.9 to 500.0°C/-199.9 to 900.0°F	-219.9 to 520.0°C/-239.9 to 940.0°F	
3	K	-50.00 to 700.00°C/-50.00 to 1280.00°F	-70.00 to 720.00°C/-160.00 to 1320.00°F *1	
4	K	-200.0 to 1300.0°C/-300.0 to 2300.0°F	-220.0 to 1320.0°C/-340.0 to 2340.0°F	
5	J	-100.0 to 850.0°C/-100.0 to 1500.0°F	-120.0 to 870.0°C/-140.0 to 1540.0°F	
6	T	-200.0 to 400.0°C/-300.0 to 700.0°F	-220.0 to 420.0°C/-340.0 to 740.0°F	
7	E	-200.0 to 600.0°C/-300.0 to 1100.0°F	-220.0 to 620.0°C/-340.0 to 1140.0°F	
8	L	-100.0 to 850.0°C/-100.0 to 1500.0°F	-120.0 to 870.0°C/-140.0 to 1540.0°F	
9	U	-200.0 to 400.0°C/-300.0 to 700.0°F	-220.0 to 420.0°C/-340.0 to 740.0°F	
10	N	-200.0 to 1300.0°C/-300.0 to 2300.0°F	-220.0 to 1320.0°C/-340.0 to 2340.0°F	
11	R	0.0 to 1700.0°C/0.0 to 3000.0°F	-20.0 to 1720.0°C/-40.0 to 3040.0°F	
12	S	0.0 to 1700.0°C/0.0 to 3000.0°F	-20.0 to 1720.0°C/-40.0 to 3040.0°F	
13	B	0.0 to 1800.0°C/0.0 to 3200.0°F	-20.0 to 1820.0°C/-40.0 to 3240.0°F	
14	C/W	0.0 to 2300.0°C/0.0 to 3200.0°F	-20.0 to 2320.0°C/-40.0 to 3240.0°F	
15	PLII	0.0 to 1300.0°C/0.0 to 2300.0°F	-20.0 to 1320.0°C/-40.0 to 2340.0°F	
16	4 to 20 mA	Usable in the following ranges by scaling -19999 to 32400 -1999.9 to 3240.0 -199.99 to 324.00 -19.999 to 32.400	-5 to 105% of the input setting range, within the data type range *1	Analog
17	0 to 20 mA			
18	1 to 5 V			
19	0 to 5 V			
20	0 to 10 V			

*1. For measured values (INT), use the INT type range if the input indication range exceeds the INT type range (-32768 to 32767).

Reference Accuracy and Temperature Coefficient Table

Reference accuracies and temperature coefficients are shown below by input type and measurement temperature.

To convert the temperature Unit from Celsius to Fahrenheit, use the following equation.

Fahrenheit temperature ($^{\circ}\text{F}$) = Celsius temperature ($^{\circ}\text{C}$) $\times 1.8 + 32$

Set values	Input type		Measurement temperature ($^{\circ}\text{C}$)	Reference accuracy $^{\circ}\text{C}$ (%)	Temperature coefficient $^{\circ}\text{C}/^{\circ}\text{C}$ *1 ($\text{ppm}/^{\circ}\text{C}$ *2)
	Sensor	Temperature range ($^{\circ}\text{C}$)			
0	Pt100	-200.0 to 500.0	-200.0 to 300.0	± 0.70 ($\pm 0.1\%$)	± 0.10 ($\pm 150 \text{ ppm}/^{\circ}\text{C}$)
			300.0 to 500.0		± 0.20 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
1	Pt100	-200.0 to 850.0	-200.0 to 300.0	± 1.0 ($\pm 0.1\%$) ± 2.0 ($\pm 0.2\%$) ± 2.5 ($\pm 0.25\%$)	± 0.1 ($\pm 100 \text{ ppm}/^{\circ}\text{C}$)
			300.0 to 700.0		± 0.2 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
			700.0 to 850.0		± 0.25 ($\pm 250 \text{ ppm}/^{\circ}\text{C}$)
2	JPt100	-199.9 to 500.0	-199.9 to 300.0	± 0.8 ($\pm 0.12\%$)	± 0.1 ($\pm 150 \text{ ppm}/^{\circ}\text{C}$)
			300.0 to 500.0		± 0.2 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
3	K	-50.0 to 700.0	-50.0 to 400.0	± 0.75 ($\pm 0.1\%$)	± 0.30 ($\pm 400 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 700.0		± 0.38 ($\pm 510 \text{ ppm}/^{\circ}\text{C}$)
4	K	-200.0 to 1300.0	-200.0 to -100.0	± 1.5 ($\pm 0.1\%$)	± 0.15 ($\pm 100 \text{ ppm}/^{\circ}\text{C}$)
			-100.0 to 400.0		± 0.30 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 1300.0		± 0.38 ($\pm 250 \text{ ppm}/^{\circ}\text{C}$)
5	J	-100.0 to 850.0	-100.0 to 400.0	± 1.4 ($\pm 0.15\%$) ± 1.2 ($\pm 0.13\%$)	± 0.14 ($\pm 150 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 850.0		± 0.28 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
6	T	-200.0 to 400.0	-200.0 to -100.0	± 1.2 ($\pm 0.2\%$)	± 0.30 ($\pm 500 \text{ ppm}/^{\circ}\text{C}$)
			-100.0 to 400.0		± 0.12 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
7	E	-200.0 to 600.0	-200.0 to 400.0	± 1.2 ($\pm 0.15\%$) ± 2.0 ($\pm 0.25\%$)	± 0.12 ($\pm 150 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 600.0		± 0.24 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
8	L	-100.0 to 850.0	-100.0 to 300.0	± 1.1 ($\pm 0.12\%$) ± 2.2 ($\pm 0.24\%$)	± 0.11 ($\pm 120 \text{ ppm}/^{\circ}\text{C}$)
			300.0 to 700.0		± 0.22 ($\pm 240 \text{ ppm}/^{\circ}\text{C}$)
			700.0 to 850.0		± 0.28 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
9	U	-200.0 to 400.0	-200.0 to 400.0	± 1.2 ($\pm 0.2\%$)	± 0.12 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
10	N	-200.0 to 1300.0	-200.0 to 400.0	± 1.5 ($\pm 0.1\%$)	± 0.30 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 1000.0		± 0.38 ($\pm 250 \text{ ppm}/^{\circ}\text{C}$)
			1000.0 to 1300.0		
11	R	0.0 to 1700.0	0.0 to 500.0	± 1.75 ($\pm 0.11\%$) ± 2.5 ($\pm 0.15\%$)	± 0.44 ($\pm 260 \text{ ppm}/^{\circ}\text{C}$)
			500.0 to 1200.0		
			1200.0 to 1700.0		
12	S	0.0 to 1700.0	0.0 to 600.0	± 2.5 ($\pm 0.15\%$)	± 0.44 ($\pm 260 \text{ ppm}/^{\circ}\text{C}$)
			600.0 to 1100.0		
			1100.0 to 1700.0		
13	B	0.0 to 1800.0	0.0 to 400.0	Reference accuracy cannot be guaranteed	Reference accuracy cannot be guaranteed
			400.0 to 1200.0		± 0.45 ($\pm 250 \text{ ppm}/^{\circ}\text{C}$)
			1200.0 to 1800.0		± 0.54 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
14	C/W	0.0 to 2300.0	0.0 to 300.0	± 1.15 ($\pm 0.05\%$) ± 2.3 ($\pm 0.1\%$) ± 3.0 ($\pm 0.13\%$)	± 0.46 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
			300.0 to 800.0		
			800.0 to 1500.0		
			1500.0 to 2300.0		± 0.691 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
15	PL II	0.0 to 1300.0	0.0 to 400.0	± 1.3 ($\pm 0.1\%$) ± 2.0 ($\pm 0.15\%$)	± 0.23 ($\pm 200 \text{ ppm}/^{\circ}\text{C}$)
			400.0 to 800.0		± 0.39 ($\pm 300 \text{ ppm}/^{\circ}\text{C}$)
			800.0 to 1300.0		± 0.65 ($\pm 500 \text{ ppm}/^{\circ}\text{C}$)

Set values	Input type		Reference accuracy (%)	Temperature coefficient ($\text{ppm}/^{\circ}\text{C}$)
	Sensor	Input range		
16	Analog current	4 to 20 mA	0.1	340 $\text{ppm}/^{\circ}\text{C}$
17	Analog current	0 to 20 mA	0.1	340 $\text{ppm}/^{\circ}\text{C}$
18	Analog voltage	1 to 5 V	0.1	340 $\text{ppm}/^{\circ}\text{C}$
19	Analog voltage	0 to 5 V	0.1	340 $\text{ppm}/^{\circ}\text{C}$
20	Analog voltage	0 to 10 V	0.1	340 $\text{ppm}/^{\circ}\text{C}$

*1. An error for a measured value when the ambient temperature changes by 1°C.

The following formula is used to calculate the error of the measured value for thermocouple inputs..

Overall accuracy = Reference accuracy + Temperature characteristic x Change in the ambient temperature + Cold junction compensation error

For resistance thermometer inputs, there is no cold junction compensation error.

(Calculation example)

- Conditions

Item	Description
Ambient temperature	30°C
Measured value	100.0°C
Thermocouple	K (4)
Reference accuracy 25°C	-200.0 to 1,300.0: $\pm 1.5^{\circ}\text{C}$

- The characteristic values are formulated from the datasheet or reference accuracy and temperature coefficient table under the above conditions

Item	Description
Reference accuracy	30°C
Temperature coefficient	-100.0 to 400.0°C: $\pm 0.30^{\circ}\text{C}/^{\circ}\text{C}$
Change in the ambient temperature	25°C > 30°C 5 deg
Cold junction compensation error	$\pm 1.2^{\circ}\text{C}$

Therefore,

Overall accuracy = Reference accuracy + Temperature characteristic x Change in the ambient temperature + Cold junction compensation error

$$= \pm 1.5^{\circ}\text{C} + (\pm 0.30^{\circ}\text{C}/^{\circ}\text{C}) \times 5 \text{ deg} + \pm 1.2^{\circ}\text{C}$$
$$= \pm 4.2^{\circ}\text{C}$$

Then the overall accuracy is $\pm 4.2^{\circ}\text{C}$.

*2. The ppm value is for the full scale of the temperature range.

Cold Junction Compensation Error Specifications for Units That Take a Thermocouple Input Type

The cold junction compensation error for thermocouple inputs is as follows.

The cold junction compensation error is $\pm 1.2^\circ\text{C}$.

However, there are exceptions depending on the input type and temperature. Those conditions and the cold junction compensation error are as in the table below.

Input type and temperature range	Cold junction compensation error
T below -90°C	
J, E, K and N below -100°C	$\pm 3.0^\circ\text{C}$
U, L and PLII	
R and S below 200°C	
B below 400°C	Not guaranteed
C/W	$\pm 3.0^\circ\text{C}$


In order to measure with accuracy

Install the cold junction sensor and its mounted Connector-Terminal Block Conversion Unit far enough away from any heat-generating elements. Otherwise, the heat from those elements increases the cold junction compensation error.

External Interface

Advanced Temperature Control Units


MIL connector type (34 poles, 2 rows) 30 mm width, 4 and 8 channels

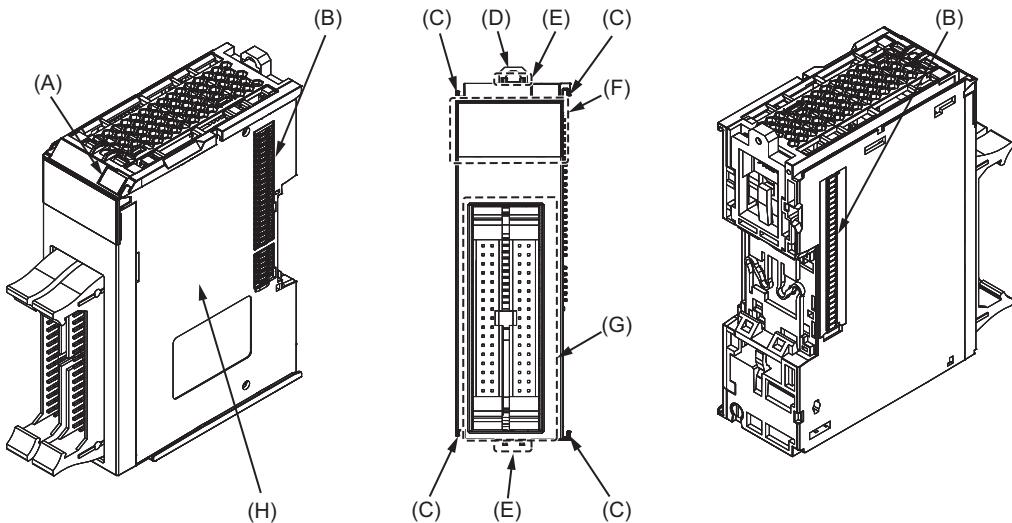

Letter	Item	Specification
(A)	Marker attachment locations	The locations where markers are attached. The markers made by OMRON are installed for the factory setting. Commercially available markers can also be installed.
(B)	NX bus connector	This connector is used to connect each Unit.
(C)	Unit hookup guides	These guides are used to connect two Units.
(D)	DIN Track mounting hooks	These hooks are used to mount the NX Unit to a DIN Track.
(E)	Protrusions for removing the Unit	The protrusions to hold when removing the Unit.
(F)	Indicators	The indicators show the current operating status of the Unit.
(G)	Connector	This connector is used to connect external devices.
(H)	Unit specifications	The specifications of the Unit are given.

The following tables show one-to-one correspondence between the MIL connector pins on the Advanced Temperature Control Unit and the terminals on the Ultra-Compact Interface Wiring System (XW2K-34G-T).

NX-HTC3510-5 (Heating and cooling Control type)

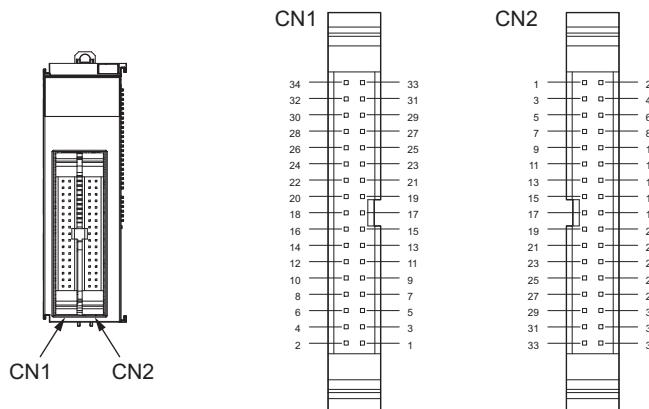

Temperature Inputs, Analog Inputs and Cold Junction Sensor Inputs (CN1)

Terminal No. (row A) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC3510-5				
	Pin	Item	Ch	I/O	Description
A1	1	A1/I1(+)	1	I	Resistance thermometer input (A) / Current input (+)
A2	3	B1/TC1(-)/V1(-)/I1(-)	1	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A3	5	B1/TC1(+)/V1(+)	1	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A4	7	A3/I3(+)	3	I	Resistance thermometer input (A) / Current input (+)
A5	9	B3/TC3(-)/V3(-)/I3(-)	3	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A6	11	B3/TC3(+)/V3(+)	3	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A7	13	CJ(B)	1 to 4	I	Cold junction sensor input (B)
A8	15	CJ(B)	1 to 4	I	Cold junction sensor input (B)
A9	17	NC	—	—	Not used
A10	19	NC	—	—	Not used
A11	21	NC	—	—	Not used
A12	23	NC	—	—	Not used
A13	25	NC	—	—	Not used
A14	27	NC	—	—	Not used
A15	29	NC	—	—	Not used
A16	31	NC	—	—	Not used
A17	33	NC	—	—	Not used


Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC3510-5				
	Pin	Item	Ch	I/O	Description
B1	2	A2/I2(+)	2	I	Resistance thermometer input (A) / Current input (+)
B2	4	B2/TC2(-)/V2(-)/I2(-)	2	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
B3	6	B2/TC2(+)/V2(+)	2	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B4	8	A4/I4(+)	4	I	Resistance thermometer input (A) / Current input (+)
B5	10	B4/TC4(-)/V4(-)/I4(-)	4	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
B6	12	B4/TC4(+)/V4(+)	4	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B7	14	NC	—	—	Not used
B8	16	CJ (A)	1 to 4	I	Cold junction sensor input (A)
B9	18	NC	—	—	Not used
B10	20	NC	—	—	Not used

Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC3510-5				
	Pin	Item	Ch	I/O	Description
B11	22	NC	—	—	Not used
B12	24	NC	—	—	Not used
B13	26	NC	—	—	Not used
B14	28	NC	—	—	Not used
B15	30	NC	—	—	Not used
B16	32	NC	—	—	Not used
B17	34	NC	—	—	Not used

CT Inputs and Control Outputs (CN2)

Terminal No. (row A) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC3510-5				
	Pin	Item	Ch	I/O	Description
A1	1	CT1	1	I	CT input
A2	3	CT2	2	I	CT input
A3	5	CT3	3	I	CT input
A4	7	CT4	4	I	CT input
A5	9	NC	—	—	Not used
A6	11	NC	—	—	Not used
A7	13	NC	—	—	Not used
A8	15	NC	—	—	Not used
A9	17	NC	—	—	Not used
A10	19	OUT1	1	O	Control output (heating) (+)
A11	21	OUT2	2	O	Control output (heating) (+)
A12	23	OUT3	3	O	Control output (heating) (+)
A13	25	OUT4	4	O	Control output (heating) (+)
A14	27	OUT5	1	O	Control output (cooling) (+)
A15	29	OUT6	2	O	Control output (cooling) (+)
A16	31	OUT7	3	O	Control output (cooling) (+)
A17	33	OUT8	4	O	Control output (cooling) (+)

Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC3510-5				
	Pin	Item	Ch	I/O	Description
B1	2	CT1	1	I	CT input
B2	4	CT2	2	I	CT input
B3	6	CT3	3	I	CT input
B4	8	CT4	4	I	CT input
B5	10	NC	—	—	Not used
B6	12	NC	—	—	Not used
B7	14	NC	—	—	Not used
B8	16	NC	—	—	Not used
B9	18	NC	—	—	Not used
B10	20	IOG1	1	O	Control output (heating) (-)
B11	22	IOG2	2	O	Control output (heating) (-)
B12	24	IOG3	3	O	Control output (heating) (-)
B13	26	IOG4	4	O	Control output (heating) (-)
B14	28	IOG5	1	O	Control output (cooling) (-)
B15	30	IOG6	2	O	Control output (cooling) (-)
B16	32	IOG7	3	O	Control output (cooling) (-)
B17	34	IOG8	4	O	Control output (cooling) (-)

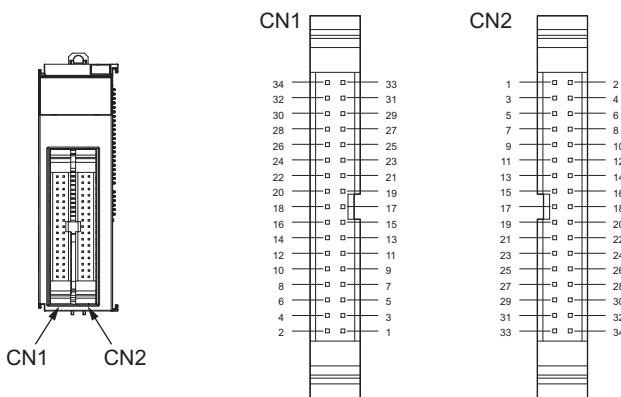NX-HTC4505-5 (Standard control type)**Temperature Inputs, Analog Inputs and Cold Junction Sensor Inputs (CN1)**

Terminal No. (row A) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC4505-5				
	Pin	Item	Ch	I/O	Description
A1	1	A1/I1(+)	1	I	Resistance thermometer input (A) / Current input (+)
A2	3	B1/TC1(-)/V1(-)/I1(-)	1	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A3	5	B1/TC1(+)/V1(+)	1	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A4	7	A3/I3(+)	3	I	Resistance thermometer input (A) / Current input (+)
A5	9	B3/TC3(-)/V3(-)/I3(-)	3	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A6	11	B3/TC3(+)/V3(+)	3	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A7	13	CJ(B)	1 to 8	I	Cold junction sensor input (B)
A8	15	CJ(B)	1 to 8	I	Cold junction sensor input (B)
A9	17	A5/I5(+)	5	I	Resistance thermometer input (A) / Current input (+)
A10	19	B5/TC5(-)/V5(-)/I5(-)	5	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A11	21	B5/TC5(+)/V5(+)	5	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A12	23	A7/I7(+)	7	I	Resistance thermometer input (A) / Current input (+)
A13	25	B7/TC7(-)/V7(-)/I7(-)	7	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
A14	27	B7/TC7(+)/V7(+)	7	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
A15	29	NC	—	—	Not used
A16	31	NC	—	—	Not used
A17	33	NC	—	—	Not used

Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC4505-5				
	Pin	Item	Ch	I/O	Description
B1	2	A2/I2(+)	2	I	Resistance thermometer input (A) / Current input (+)
B2	4	B2/TC2(-)/V2(-)/I2(-)	2	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
B3	6	B2/TC2(+)/V2(+)	2	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B4	8	A4/I4(+)	4	I	Resistance thermometer input (A) / Current input (+)
B5	10	B4/TC4(-)/V4(-)/I4(-)	4	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
B6	12	B4/TC4(+)/V4(+)	4	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B7	14	NC	—	—	Not used
B8	16	CJ(A)	1 to 8	I	Cold junction sensor input (A)
B9	18	A6/I6(+)	6	I	Resistance thermometer input (A) / Current input (+)
B10	20	B6/TC6(-)/V6(-)/I6(-)	6	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)
B11	22	B6/TC6(+)/V6(+)	6	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B12	24	A8/I8(+)	8	I	Resistance thermometer input (A) / Current input (+)
B13	26	B8/TC8(-)/V8(-)/I8(-)	8	I	Resistance thermometer input (B) / Thermocouple input (-) / Voltage input (-) / Current input (-)

Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC4505-5				
	Pin	Item	Ch	I/O	Description
B14	28	B8/TC8(+)/V8(+)	8	I	Resistance thermometer input (B) / Thermocouple input (+) / Voltage input (+)
B15	30	NC	—	—	Not used
B16	32	NC	—	—	Not used
B17	34	NC	—	—	Not used


CT Inputs and Control Outputs (CN2)

Terminal No. (row A) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC4505-5				
	Pin	Item	Ch	I/O	Description
A1	1	CT1	1	I	CT input
A2	3	CT2	2	I	CT input
A3	5	CT3	3	I	CT input
A4	7	CT4	4	I	CT input
A5	9	CT5	5	I	CT input
A6	11	CT6	6	I	CT input
A7	13	CT7	7	I	CT input
A8	15	CT8	8	I	CT input
A9	17	NC	—	—	Not used
A10	19	OUT1	1	O	Control output (heating) (+)
A11	21	OUT2	2	O	Control output (heating) (+)
A12	23	OUT3	3	O	Control output (heating) (+)
A13	25	OUT4	4	O	Control output (heating) (+)
A14	27	OUT5	5	O	Control output (heating) (+)
A15	29	OUT6	6	O	Control output (heating) (+)
A16	31	OUT7	7	O	Control output (heating) (+)
A17	33	OUT8	8	O	Control output (heating) (+)

Terminal No. (row B) of XW2K-34G-T	Connector pins (MIL connector) on NX-HTC4505-5				
	Pin	Item	Ch	I/O	Description
B1	2	CT1	1	I	CT input
B2	4	CT2	2	I	CT input
B3	6	CT3	3	I	CT input
B4	8	CT4	4	I	CT input
B5	10	CT5	5	I	CT input
B6	12	CT6	6	I	CT input
B7	14	CT7	7	I	CT input
B8	16	CT8	8	I	CT input
B9	18	NC	—	—	Not used
B10	20	IOG1	1	O	Control output (heating) (-)
B11	22	IOG2	2	O	Control output (heating) (-)
B12	24	IOG3	3	O	Control output (heating) (-)
B13	26	IOG4	4	O	Control output (heating) (-)
B14	28	IOG5	5	O	Control output (heating) (-)
B15	30	IOG6	6	O	Control output (heating) (-)
B16	32	IOG7	7	O	Control output (heating) (-)
B17	34	IOG8	8	O	Control output (heating) (-)

Connection Method Using the Connector-Terminal Block Conversion Unit

Connection example

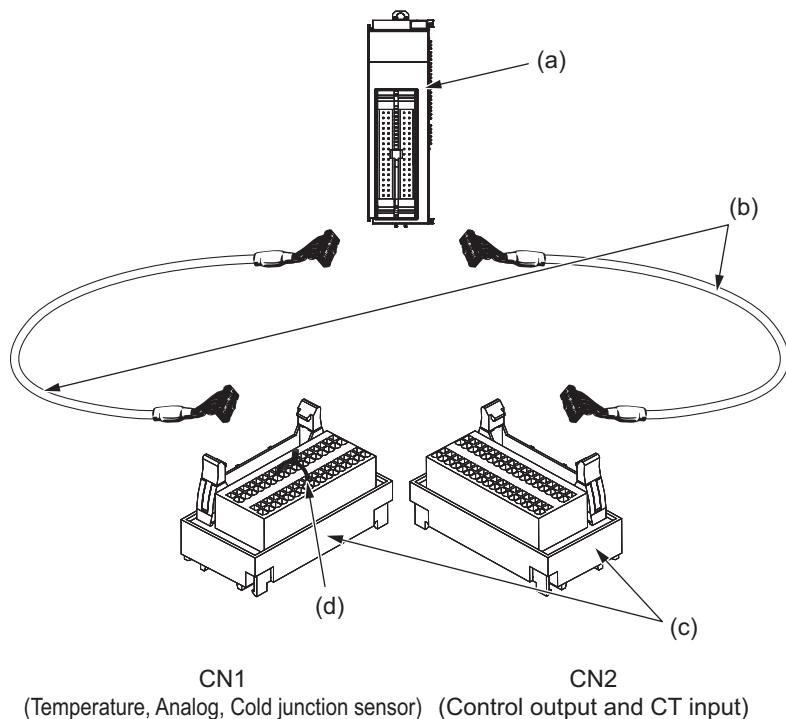

CN1
(Temperature, Analog, Cold junction sensor) CN2
(Control output and CT input)

Letter	Product name	Model	Description
(a)	Advanced Temperature Control Units	NX-HTC□□□□	It is a Temperature Control Unit with advanced features.
(b)	Connecting Cables for Interface Wiring System (Shielded)	XW2Z-□□□EE	It is a straight cable (shielded) with 34-pole MIL connector.
(c)	Ultra-Compact Interface Wiring System	XW2K-34G-T	It is a 34-pole Ultra-Compact Interface Wiring System of general-purpose type and converts the MIL connector to a push-in Plus terminal block connector. The cold junction sensor provided with each Advanced Temperature Control Unit is mounted on the CN1.
(d)	Cold Junction Sensor	NX-AUX03	It is provided with each Advanced Temperature Control Unit and is connected to the CN1 of the Ultra-Compact Interface Wiring System.

Recommended Connector-Terminal Block Conversion Unit and Dedicated Cable

Product name	Manufacturer	Model	Appearance
Ultra-Compact Interface Wiring System	OMRON	XW2K-34G-T	
Connecting Cables for Interface Wiring System (Shielded)	OMRON	XW2Z-□□□EE	

Recommended Ferrules and Crimp Tools

The applicable ferrules, wires, and crimping tool are given in the following table.

Applicable wire

Applicable wire	Stranded wire / Solid wire	0.08 to 1.5 mm ² (AWG 28 to 16)
	Ferrules	With insulation sleeve: 0.14 to 0.5 mm ² (AWG 26 to 20) Without insulation sleeve: 0.75 to 1.5 mm ² (AWG 18 to 16)

XW2K

Applicable wire		Ferrule Conductor length (mm)	Stripping length (mm) (Ferrules used)	Recommended ferrules		
(mm ²)	(AWG)			Manufactured by Phoenix Contact *	Manufactured by Weidmuller	Manufactured by Wago
0.14	26	8	10	AI 0,14-8	H0.14/12	---
0.25	24	8	10	AI 0,25-8	H0.25/12	216-301
		10	12	AI 0,25-10	---	---
0.34	22	8	10	AI 0,34-8	H0.34/12	216-302
		10	12	AI 0,34-10	---	---
0.50	20	8	10	AI 0,5-8	H0.5/14	216-201
		10	12	AI 0,5-10	H0.5/16	216-241
Recommended crimp tools			CRIMPFOX6 CRIMPFOX6T-F CRIMPFOX10S	PZ6 roto	Variocrimp4	


* The above recommended ferrules manufactured by Phoenix Contact do not include models ending in "-GB".

Models ending in "-GB" are not recommended because the inner diameter of the insulation sleeve is larger than standard model (models not ending in "-GB").

Note:

1. Make sure that the outer diameter of the wire is smaller than the inner diameter of the insulation sleeve of the recommended ferrule.
2. Make sure that the ferrule processing dimensions conform to the following figure.

Processing dimensions of ferrules




3. For the ferrule which is for applicable wire (0.75 to 1.5 mm²/ AWG 18 to 16), please use a ferrule without an insulation sleeve. (Refer to the following table.)

Applicable wire		Ferrule Conductor length (mm)	Stripping length (mm) (Ferrules used)	Recommended ferrules		
(mm ²)	(AWG)			Manufactured by Phoenix Contact	Manufactured by Weidmuller	Manufactured by Wago
0.75	18	8	10	A 0,75-8	---	F-0.75-8
		10	12	A 0,75-10	H0,75/10	F-0.75-10
1/1.25	18/17	8	8	A 1-8	---	F-1.0-8
		10	10	A 1-10	H1,0/10	F-1.0-10
1.25/ 1.5	17/16	10	10	A 1,5-10	H1,5/10	F-1.5-10
Recommended crimp tools			CRIMPFOX6 CRIMPFOX6T-F CRIMPFOX10S	PZ6 roto	Variocrimp4	

Recommended Flat-blade Screwdriver

Use a flat-blade screwdriver to connect and remove wires. Use the following flat-blade screwdriver. The following table shows manufacturers and models as of 2021/Dec.

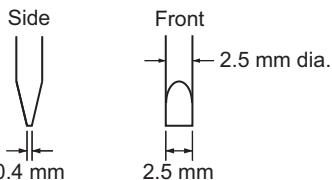


Model	Manufacturer
ESD 0,40×2,5	Wera
SZS 0,4×2,5 SZF 0-0,4×2,5 *	Phoenix Contact
0.4×2.5×75 302	Wiha
AEF.2,5×75	Facom
210-719	Wago
SDIS 0.4×2.5×75	Weidmuller
9900(-2.5×75)	Vessel

* OMRON's exclusive purchase model XW4Z-00B is available to order as SZF 0-0,4 x 2,5 (manufactured by Phoenix Contact).

Dimensions

Advanced Temperature Control Units

30 mm Width

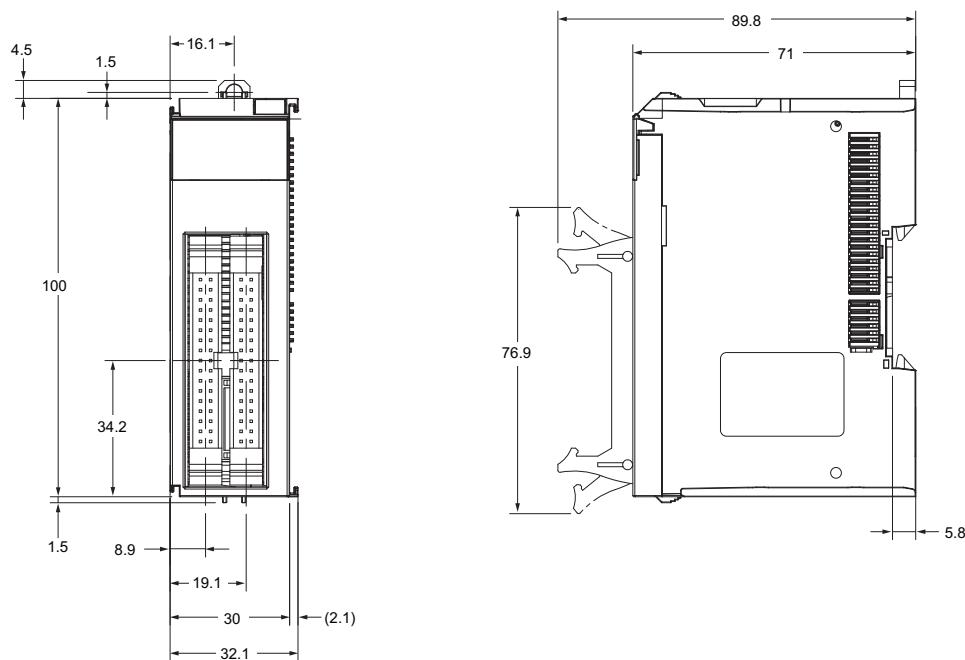

Related Manual

Cat. No.	Model number	Manual name	Application	Description
H238	NX-HTC□□□□	NX-series Advanced Temperature Control Units User's Manual	Learning how to use NX-series Advanced Temperature Control Units.	The hardware, setup methods, and functions of the NX-series Advanced Temperature Control Units are described.

MEMO

Terms and Conditions Agreement

Read and understand this catalog.

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

Warranties.

(a) Exclusive Warranty. Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied.

(b) Limitations. OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE.

Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) Buyer Remedy. Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty.

See <http://www.omron.com/global/> or contact your Omron representative for published information.

Limitation on Liability: Etc.

OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY.

Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.

Suitability of Use.

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

Programmable Products.

Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.

Performance Data.

Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.

Change in Specifications.

Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.

Errors and Omissions.

Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

Note: Do not use this document to operate the Unit.

OMRON Corporation Industrial Automation Company

Kyoto, JAPAN

Contact : www.ia.omron.com

Regional Headquarters

OMRON EUROPE B.V.
Wegalaan 67-69, 2132 JD Hoofddorp
The Netherlands
Tel: (31) 2356-81-300 Fax: (31) 2356-81-388

OMRON ASIA PACIFIC PTE. LTD.
438B Alexandra Road, #08-01/02 Alexandra
Technopark, Singapore 119968
Tel: (65) 6835-3011 Fax: (65) 6835-3011

OMRON ELECTRONICS LLC
2895 Greenspoint Parkway, Suite 200
Hoffman Estates, IL 60169 U.S.A.
Tel: (1) 847-843-7900 Fax: (1) 847-843-7787

OMRON (CHINA) CO., LTD.
Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120, China
Tel: (86) 21-6023-0333 Fax: (86) 21-5037-2388

Authorized Distributor:

©OMRON Corporation 2017-2023 All Rights Reserved.
In the interest of product improvement,
specifications are subject to change without notice.

CSM_2_2
Cat. No. H229-E1-06 1123 (1217)