


DATA SHEET

TB5600, TB5610, TB5620, TB5640, TB5660

Terminal base

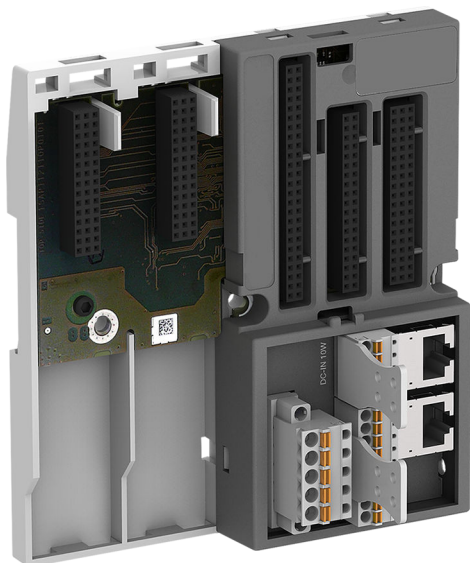

1 Ordering data

Part no.	Description	Product life cycle phase *)
1SAP 110 300 R0278	TB5600-2ETH, terminal base AC500, slots: 1 processor module, 2 Ethernet RJ45, 1 CAN connector	Active
1SAP 310 300 R0278	TB5600-2ETH-XC, terminal base AC500, slots: 1 processor module, 2 Ethernet RJ45, 1 CAN connector, XC version	Active
1SAP 111 300 R0278	TB5610-2ETH, terminal base AC500, slots: 1 processor module, 1 communication module, 2 Ethernet RJ45, 1 CAN connector	Active
1SAP 311 300 R0278	TB5610-2ETH-XC, terminal base AC500, slots: 1 processor module, 1 communication module, 2 Ethernet RJ45, 1 CAN connector, XC version	Active
1SAP 112 300 R0278	TB5620-2ETH, terminal base AC500, slots: 1 processor module, 2 communication modules, 2 Ethernet RJ45, 1 CAN connector	Active
1SAP 312 300 R0278	TB5620-2ETH-XC, terminal base AC500, slots: 1 processor module, 2 communication modules, 2 Ethernet RJ45, 1 CAN connector, XC version	Active

Part no.	Description	Product life cycle phase *)
1SAP 114 300 R0278	TB5640-2ETH, terminal base AC500, slots: 1 processor module, 4 communication modules, 2 Ethernet RJ45, 1 CAN connector	Active
1SAP 314 300 R0278	TB5640-2ETH-XC, terminal base AC500, slots: 1 processor module, 4 communication modules, 2 Ethernet RJ45, 1 CAN connector, XC version	Active
1SAP 116 300 R0278	TB5660-2ETH, terminal base AC500, slots: 1 processor module, 6 communication modules, 2 Ethernet RJ45, 1 CAN connector	Active
1SAP 316 300 R0278	TB5660-2ETH-XC, terminal base AC500, slots: 1 processor module, 6 communication modules, 2 Ethernet RJ45, 1 CAN connector, XC version	Active



*) Modules in lifecycle Classic are available from stock but not recommended for planning and commissioning of new installations.


Table 1: Combination of TB56xx-2ETH(-XC) and PM56xx(-XC)

Processor module	PM5630	PM5650	PM5670	PM5675
TB5600-2ETH	0 slot	0 slot	0 slot	0 slot
TB5610-2ETH	1 slot	1 slot	1 slot	1 slot
TB5620-2ETH	2 slots	2 slots	2 slots	2 slots
TB5640-2ETH	-	4 slots	4 slots	4 slots
TB5660-2ETH	-	-	6 slots ¹⁾	6 slots ¹⁾
Remarks: The slots can be used for connecting communication modules or AC500-S modules. Note that only one AC500-S module can be connected at one terminal base. ¹⁾ PM567x must have an index $\geq C0$.				

Table 2: Accessories

Part no.	Description
1SAP 180 800 R0001	TA526, wall mounting accessory

2 Dimensions

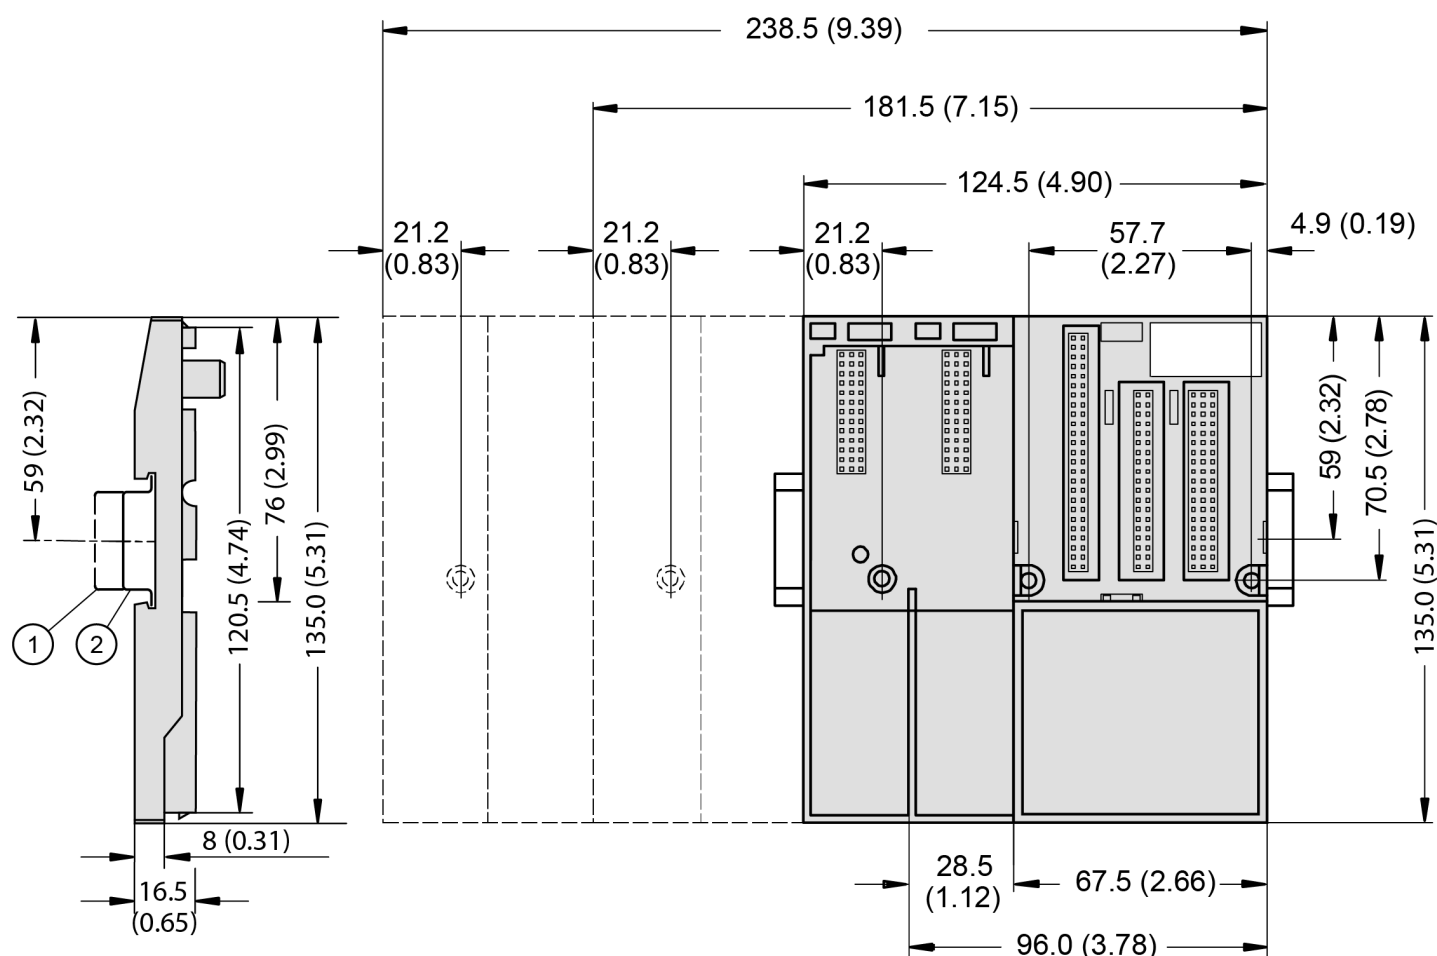

- 1 Din rail 15 mm
- 2 Din rail 7.5 mm



The dimensions are in mm and in brackets in inch.

3 Technical data

The system data of AC500 and S500 are applicable to the standard version. ➤ *Chapter 4 “System data AC500” on page 4*

The system data of AC500-XC are applicable to the XC version. ➤ *Chapter 5 “System data AC500-XC” on page 8*

Only additional details are therefore documented below.

The technical data are also applicable to the XC version.

Parameter	Value
Connection of the supply voltage 24 V DC at the terminal base of the processor module	Removable 5-pin terminal block spring type
Max. current consumption from 24 V DC	TB5600: 0.3 A ¹⁾ TB5610: 0.4 A ¹⁾ TB5620: 0.5 A ¹⁾ TB5640: 0.65 A ¹⁾ TB5660: 0.8 A ¹⁾
Melting integral of a fuse at 24 V DC	Min. 1 A ² s ²⁾
Peak inrush current from 24 V DC	55 A ²⁾
Number of slots for processor modules	1 (on all terminal bases)
Processor module interfaces at TB56xx	I/O bus, ETH1, ETH2, CAN, COM1
Net weight (terminal base without processor module)	TB5600: 155 g TB5610: 180 g TB5620: 210 g TB5640: 260 g TB5660: 310 g
Mounting position	Horizontal or vertical

¹⁾ Including processor modules, communication modules and I/O bus supply.

²⁾ The inrush current and the melting integral depends on the internal power supply of the processor module and the number and type of communication modules and I/O modules connected to the I/O bus.

Table 3: Combination of TB56xx-2ETH(-XC) and PM56xx(-XC)

Processor module	PM5630	PM5650	PM5670	PM5675
TB5600-2ETH	0 slot	0 slot	0 slot	0 slot
TB5610-2ETH	1 slot	1 slot	1 slot	1 slot
TB5620-2ETH	2 slots	2 slots	2 slots	2 slots
TB5640-2ETH	-	4 slots	4 slots	4 slots
TB5660-2ETH	-	-	6 slots ¹⁾	6 slots ¹⁾
Remarks: The slots can be used for connecting communication modules or AC500-S modules. Note that only one AC500-S module can be connected at one terminal base. ¹⁾ PM567x must have an index \geq C0.				

4 System data AC500


4.1 Environmental conditions

Table 4: Process and supply voltages

Parameter	Value
24 V DC	
Voltage	24 V (-15 %, +20 %)
Protection against reverse polarity	Yes

Parameter		Value
100 V AC...240 V AC wide-range supply		
	Voltage	100 V ... 240 V (-15 %, +10 %)
	Frequency	50/60 Hz (-6 %, +4 %)
Allowed interruptions of power supply, according to EN 61131-2		
	DC supply	Interruption < 10 ms, time between 2 interruptions > 1 s, PS2
	AC supply	Interruption < 0.5 periods, time between 2 interruptions > 1 s

**NOTICE!****Risk of damaging the PLC due to improper voltage levels!**

- Never exceed the maximum tolerance values for process and supply voltages.
 - Never fall below the minimum tolerance values for process and supply voltages.
- Observe the **system data**  *Chapter 4 “System data AC500” on page 4* and the **technical data** of the module used.

**NOTICE!**

Improper voltage level or frequency range which cause damage of AC inputs:

- AC voltage above 264 V.
- Frequency below 47 Hz or above 62.4 Hz.

**NOTICE!**

Improper connection leads cause overtemperature on terminals.

PLC modules may be destroyed by using wrong cable type, wire size and cable temperature classification.

Parameter		Value
Temperature		
	Operating	0 °C ... +60 °C: Horizontal mounting of modules. 0 °C ... +40 °C: Vertical mounting of modules. Output load reduced to 50 % per group.
	Storage	-40 °C ... +70 °C
	Transport	-40 °C ... +70 °C
Humidity		Max. 95 %, without condensation
Air pressure		
	Operating	> 800 hPa / < 2000 m
	Storage	> 660 hPa / < 3500 m

4.2 Creepage distances and clearances

The creepage distances and clearances meet the requirements of the overvoltage category II, pollution degree 2.

4.3 Power supply units



AC500 and AC500-eCo PLC devices are Class II/Class III devices and do not require a Protective Earth (PE) connection.

For proper EMC performance, all metal parts, DIN rails, mounting screws, and cable shield connection terminals are connected to a common ground and provide Functional Earth (FE). This is typically connected to a common reference potential, such as equipotential bonding rails.

Signal Grounds (SGND or GND) are used for signal reference and must not be connected to cable shields, FE or other signals unless otherwise specified in the specific device description.

For the supply of the modules, power supply units according to SELV or PELV specifications must be used.



Safety Extra Low Voltage (SELV) and Protective Extra Low Voltage (PELV)

To ensure electrical safety of AC500/AC500-eCo extra low voltage circuits, 24 V DC supply, communication interfaces, I/O circuits, and all connected devices must be powered from sources meeting requirements of SELV, PELV, class 2, limited voltage or limited power according to applicable standards.



WARNING!

Improper installation can lead to death by touching hazardous voltages!

To avoid personal injury, safe separation, double or reinforced insulation and separation of the primary and secondary circuit must be observed and implemented during installation.

- Only use power converters for safety extra-low voltages (SELV) with safe galvanic separation of the primary and secondary circuit.
- Safe separation means that the primary circuit of mains transformers must be separated from the secondary circuit by double or reinforced insulation. The protective extra-low voltage (PELV) offers protection against electric shock.

4.4 Electromagnetic compatibility

Table 5: Electromagnetic compatibility

Parameter	Value
Device suitable only as <i>Control Equipment for Industrial Applications</i> , including marine applications. IEC 61131-2, zone B Chapter 4.6 “Approvals and certifications” on page 8	
Radiated emission according to IEC 61000-6-4 CISPR11, class A	Yes
Conducted emission according to IEC 61000-6-4 CISPR11, class A	Yes
Electrostatic discharge (ESD) according to IEC 61000-4-2, criterion B	Air discharge: 8 kV Contact discharge: 6 kV

Parameter	Value
Fast transient interference voltages (burst) according to IEC 61000-4-4, criterion B	Power supply (DC): 2 kV Digital inputs/outputs (24 V DC): 1 kV Digital inputs/outputs (240 V AC): 2 kV Analog inputs/outputs: 1 kV Communication lines shielded: 1 kV
High energy transient interference voltages (surge) according to IEC 61000-4-5, criterion B	Power supply (DC): - Line to ground: 1 kV - Line to line: 0,5 kV Digital inputs/outputs/relay: (24 V DC): - Line to ground: 1 kV (AC): - Line to ground: 2 kV - Line to line: 1 kV Analog inputs/outputs: - Line to ground: 1 kV Communication lines: - Line to ground: 1 kV
Influence of radiated disturbances IEC 61000-4-3, criterion A	Test field strength: 10 V/m
Influence of line-conducted interferences IEC 61000-4-6, criterion A	Test voltage: 10 V
Power frequency magnetic fields IEC 61000-4-8, criterion A	30 A/m 50 Hz 30 A/m 60 Hz

4.5 Mechanical data

Parameter	Value
Mounting	Horizontal/Vertical
Wiring method	Spring/screw terminals
Degree of protection	PLC system: IP 20 <ul style="list-style-type: none"> • With all modules or option boards plugged in. • With all terminals plugged in. • With all covers closed.
Housing	Classification V-2 according to UL 94
Vibration resistance (sinusoidal) acc. to IEC 60068-2-6	All three axes 2 Hz ... 8.4 Hz, 3.5 mm peak, 8.4 Hz ... 150 Hz, 1 g
Shock test acc. to IEC 60068-2-27	All three axes 15 g, 11 ms, half-sinusoidal
Mounting of the modules:	

Parameter	Value
Mounting Rail Top Hat according to IEC 60715	35 mm, depth 7.5 mm or 15 mm
Mounting with screws	M4
Fastening torque	1.2 Nm

4.6 Approvals and certifications

The PLC Automation catalog contains an [overview of the available approvals and certifications](#).

5 System data AC500-XC

5.1 Environmental conditions

Table 6: Process and supply voltages

Parameter	Value
24 V DC	
Voltage	24 V (-15 %, +20 %)
Protection against reverse polarity	Yes
100 V AC...240 V AC wide-range supply	
Voltage	100 V ... 240 V (-15 %, +10 %)
Frequency	50/60 Hz (-6 %, +4 %)
Allowed interruptions of power supply, according to EN 61131-2	
DC supply	Interruption < 10 ms, time between 2 interruptions > 1 s, PS2
AC supply	Interruption < 0.5 periods, time between 2 interruptions > 1 s



NOTICE!

Risk of damaging the PLC due to improper voltage levels!

- Never exceed the maximum tolerance values for process and supply voltages.
- Never fall below the minimum tolerance values for process and supply voltages. Observe the **system data** [Chapter 4 “System data AC500” on page 4](#) and the **technical data** of the module used.



NOTICE!

Improper voltage level or frequency range which cause damage of AC inputs:

- AC voltage above 264 V.
- Frequency below 47 Hz or above 62.4 Hz.



NOTICE!

Improper connection leads cause overtemperature on terminals.

PLC modules may be destroyed by using wrong cable type, wire size and cable temperature classification.

Parameter		Value
Temperature		
	Operating	<p>-40 °C ... +70 °C</p> <p>-40 °C ... 0 °C: Due to the LCD technology, the display might respond very slowly.</p> <p>-40 °C ... +40 °C: Vertical mounting of modules possible, output load limited to 50 % per group</p> <p>+60 °C ... +70 °C with the following deratings:</p> <ul style="list-style-type: none"> • System is limited to maximum 2 communication modules per terminal base. • Digital inputs: maximum number of simultaneously switched on input channels limited to 75 % per group (e.g. 8 channels => 6 channels). • Digital outputs: output current maximum value (all channels together) limited to 75 % per group (e.g. 8 A => 6 A). • Analog outputs only if configured as voltage output: maximum total output current per group is limited to 75 % (e.g. 40 mA => 30 mA). • Analog outputs only if configured as current output: maximum number of simultaneously used output channels limited to 75 % per group (e.g. 4 channels => 3 channels).
	Storage / Transport	-40 °C ... +85 °C
Humidity		Operating / Storage: 100 % r. H. with condensation
Air pressure		<p>Operating:</p> <p>-1000 m 5000 m (1080 hPa ... 620 hPa)</p> <p>> 2000 m (< 795 hPa):</p> <ul style="list-style-type: none"> • Maximum operating temperature must be reduced by 10 K for each 1000 m exceeding 2000 m. • I/O module relay contacts must be operated with 24 V nominal only.
Immunity to corrosive gases		<p>Yes, according to:</p> <p>ISA S71.04.1985 Harsh group A, G3/GX</p> <p>IEC60068-2-60</p> <p>Method 4 with the following concentrations:</p> <ul style="list-style-type: none"> • H2S 100 ± 10ppb • NO2 1250 ± 20ppb • CL2 100 ± 10ppb • SO2 300 ± 20ppb
Immunity to salt mist		Yes, horizontal mounting only, according to IEC 60068-2-52 severity level: 1



NOTICE!

Risk of corrosion!

Unused connectors and slots may corrode if XC devices are used in salt-mist environments.

Protect unused connectors and slots with TA535 protective caps for XC devices.



NOTICE!

Risk of malfunctions!

Unused slots for communication modules are not protected against accidental physical contact.

- Unused slots for communication modules must be covered with dummy communication modules to achieve IP20 rating.
- I/O bus connectors must not be touched during operation.

5.2 Creepage distances and clearances

The creepage distances and clearances meet the requirements of the overvoltage category II, pollution degree 2.

5.3 Power supply units



AC500 and AC500-eCo PLC devices are Class II/Class III devices and do not require a Protective Earth (PE) connection.

For proper EMC performance, all metal parts, DIN rails, mounting screws, and cable shield connection terminals are connected to a common ground and provide Functional Earth (FE). This is typically connected to a common reference potential, such as equipotential bonding rails.

Signal Grounds (SGND or GND) are used for signal reference and must not be connected to cable shields, FE or other signals unless otherwise specified in the specific device description.



Safety Extra Low Voltage (SELV) and Protective Extra Low Voltage (PELV)

To ensure electrical safety of AC500/AC500-eCo extra low voltage circuits, 24 V DC supply, communication interfaces, I/O circuits, and all connected devices must be powered from sources meeting requirements of SELV, PELV, class 2, limited voltage or limited power according to applicable standards.


**WARNING!****Improper installation can lead to death by touching hazardous voltages!**

To avoid personal injury, safe separation, double or reinforced insulation and separation of the primary and secondary circuit must be observed and implemented during installation.

- Only use power converters for safety extra-low voltages (SELV) with safe galvanic separation of the primary and secondary circuit.
- Safe separation means that the primary circuit of mains transformers must be separated from the secondary circuit by double or reinforced insulation. The protective extra-low voltage (PELV) offers protection against electric shock.

5.4 Electromagnetic compatibility

Table 7: Electromagnetic compatibility

Parameter	Value
Device suitable only as <i>Control Equipment for Industrial Applications</i> , including marine applications. IEC 61131-2, zone B  Chapter 5.6 “Approvals and certifications” on page 12	
Radiated emission according to IEC 61000-6-4 CISPR11, class A	Yes
Conducted emission according to IEC 61000-6-4 CISPR11, class A	Yes
Electrostatic discharge (ESD) according to IEC 61000-4-2, criterion B	Air discharge: 8 kV Contact discharge: 6 kV
Fast transient interference voltages (burst) according to IEC 61000-4-4, criterion B	Power supply (DC): 4 kV Digital inputs/outputs (24 V DC): 2 kV Digital inputs/outputs (240 V AC): 4 kV Analog inputs/outputs: 2 kV Communication lines shielded: 2 kV
High energy transient interference voltages (surge) according to IEC 61000-4-5, criterion B	Power supply (DC): - Line to ground: 1 kV - Line to line: 0,5 kV Digital inputs/outputs/relay: (24 V DC): - Line to ground: 1 kV (AC): - Line to ground: 2 kV - Line to line: 1 kV Analog inputs/outputs: - Line to ground: 1 kV Communication lines: - Line to ground: 1 kV

Parameter	Value
Influence of radiated disturbances IEC 61000-4-3, criterion A	Test field strength: 10 V/m
Influence of line-conducted interferences IEC 61000-4-6, criterion A	Test voltage: 10 V
Power frequency magnetic fields IEC 61000-4-8, criterion A	30 A/m 50 Hz 30 A/m 60 Hz

5.5 Mechanical data

Parameter	Value
Mounting	Horizontal/vertical (no application in salt mist environment)
Wiring method	Spring terminals
Degree of protection	PLC system: IP 20 <ul style="list-style-type: none"> • With all modules or option boards plugged in. • With all terminals plugged in. • With all covers closed.
Housing	Classification V-2 according to UL 94
Vibration resistance (sinusoidal) acc. to IEC 60068-2-6	2 Hz ... 8.4 Hz, 3.5 mm peak, 8.4 Hz ... 500 Hz, 2 g
Vibration resistance (broadband random) acc. to IEC 60068-2-64	5 Hz ... 500 Hz, 1.9 g rms (operational) 5 Hz ... 500 Hz, 4 g rms (non operational)
Shock resistance	All three axes 15 g, 11 ms, half-sinusoidal
Mounting of the modules:	
Mounting Rail Top Hat according to IEC 60715	35 mm, depth 7.5 mm or 15 mm
Mounting with screws	M4
Fastening torque	1.2 Nm

5.6 Approvals and certifications

The PLC Automation catalog contains an [*overview of the available approvals and certifications*](#).